

Reduction in Cooling Load by Using Passive Cooling Technique for Conference Hall

Gulab Chand Sahu¹, Abhishek Kumar Jain²

¹Assistant Professor, department of Mechanical Engineering, Kruti Institute of Technology and Engineering, Raipur (C.G.) 492001

²Head & Assistant professor, Department of Mechanical Engineering, Kruti Institute of Technology and Engineering, Raipur (C.G.) 492001

Abstract: *Passive cooling technique uses non-mechanical methods to maintain a comfortable indoor temperature. Passive cooling techniques can be reduced the peak cooling load in buildings, thus reducing the size of the air conditioning apparatus and the period for which it is usually required thereby affecting the impact on the environment. This paper presents cooling load calculation by using CLTD method for a conference hall. The cooling load calculation has been worked out by considering various parameters. The calculation has been worked out using MS-Excel program. The results so obtained have been compared with those of simulation technique HAP 4.5. It is a computer based program developed by Carrier Company which aids in calculating the cooling load based on ASHRAE standards. After obtaining cooling load, a system is installed in the conditioned space to reduce the cooling load which results in energy saving, cost saving and also the reduction in CO₂ emission. This system is ground water heat exchanger which circulates the ground water through the pipe in the wall and reduces the inside temperature which ultimately reduces the cooling load. MAT LAB software is using for estimating various parameters of Ground Source Heat Pump.*

Keywords: Cooling Load Temperature Difference, Cooling Load, Air Conditioning, and Ground Source Heat Exchanger

1. Introduction

In the past two decades, technology of energy foundations and other thermo-active ground-source systems has developed immensely yet Austria is still pioneering. Since 2005 more than 7,000 energy piles per year have been installed, presently resulting in a total number of approx 100,000 energy piles, ranging from small diameter driven piles to large diameter bored piles. In fact “Energy diaphragm walls” (slurry ditch walls) have become a frequently used alternative to energy piles in Austria [1]. Along with the development of the modern society a very serious problem is energy shortage. Renewable and sustainable energy offers a feasible and effective solution to counter the effects of this problem. Due to their higher energy consumption efficiencies, it has been used for years in developed and developing countries replacing or as a supplementary to the conventional air conditioning systems. GSHP systems are clean technologies using renewable energy resources. Due of the imbalance of cooling and heating demands in the residential and commercial buildings in a year, the Ground Source Heat Pump systems must be integrated with other additional energy storage systems in cooling-dominated or heating-dominated areas. For the efficient utilization of renewable energy and energy conservation the use of TES systems are strategic and use of other necessary technologies is necessary [1]. In the past decade awareness of climate change and environmental pollution issues has increased dramatically. Interest in utilizing alternative energies to improve energy competence and reduce ecological risks is growing rapidly. Geothermal energy utilized by ground source heat pumps (GSHP also well-known as geothermal heat pump, includes systems that deliver either heat or cooling to the end user) is a new and promising energy available. It is environmentally friendly, low life-safety risk and has low maintenance cost. Heat pumps employ work to transport energy from a cold source

to a warm sink. A GSHP typically uses the ground as a heat source during the heating season and a heat sink during the cooling season [2]. Commercial and institutional buildings represent 12% of all secondary energy use, with 50% of this total going to towards space heating and space cooling. Offices account for over 40% of the floor area in this sector, and therefore represent a prominent target for energy use reductions [3]. In the building the conventional ground heat exchanger is extracted from the soil by means of heat pump. The ground operates as heat source supplying warm energy to building during winter season, while in summer it treated as heat sink when cold energy of building is required. There are two types of conventional ground heat exchangers. The 1st is open loop system where the groundwater is used as a heat carrier and pumped directly from an aquifer to the heat pump. The 2nd is closed loop arrangement where closed-coils absorber pipes are surrounded into borehole, laid either horizontally or vertically [4].

1.1 Passive Cooling Technology

Set Building, energy and environment are the key issues in the developing country like India, and recently, there has been rising interest in analyzing the solar heat gains and energy use inside the building envelop. Without affecting the indoor environmental quality (IEQ), the research aids to reduce energy use by adopting different building elements with enhanced thermal performance and thus reducing the size of the air conditioning system. The energy crisis in developing countries for the duration of summer season is mainly due to cooling load requirement in buildings. To reduce the cooling load, passive cooling structural design is the most sustainable method [9].

The merits of Passive Cooling Techniques are mentioned as under they enhance utilization of Non-Conventional Energy Sources like Sun, Wind etc. They are green technology(s),

hence, are technically cleaner, i.e. Non-Polluting. They often incorporate very less or no running costs.

1.2 Ground Source Heat Pump and Heat Exchanger

Central heating and/or cooling system that transfers heat to or from the ground by means of geothermal heat pump or ground source heat pump (GSHP). Earth is used as a heat source in the winter session or a heat sink in the summer session. Open systems directly utilize the ground's thermal storage medium. Ground water is pumped from a well to the Heating system to provide thermal energy to the secondary component with the help of the heat pump. Once the heating operation, water (at a significantly unusual temperature) is either injected back into the aquifer (using a second well) or predisposed off in surface water bodies. Although these systems have been widely used and involve lower initial costs, technical long-term high financial, technical environmental risks have become apparent.

2. Practical Evaluation

This project uses the direct circulation of ground water from 80m depth rather than the use of energy pile system, which works on the temperature difference between soil and water. There is direct circulation of ground water through circulating pump due to the temperature gradient between the ground water and cooling space temperature. The heat transfer takes from cooling space to the ground water and due to this heat transfer activity the cooling space is maintained at comfortable temperature. The proposed system and circulation of pipe on the wall is given in figure (1).

The circulating pump sucks the water from the sump level which is 80m below to the ground level and circulates the water through the pipe, the pipe is placed between the two walls of the conditioned space and extracts heat from the room.

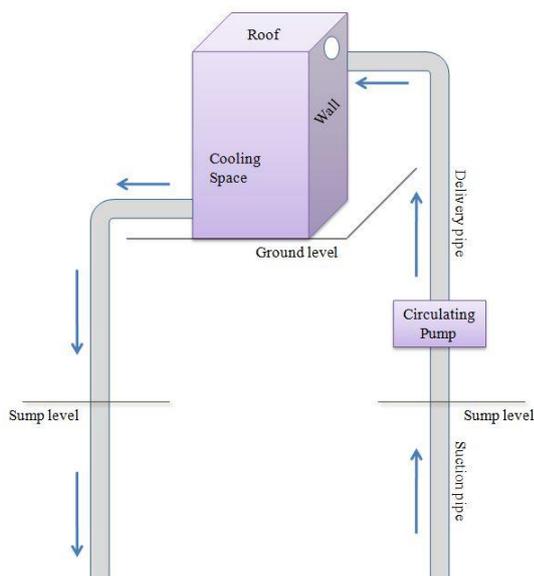


Figure 1: GSHP System

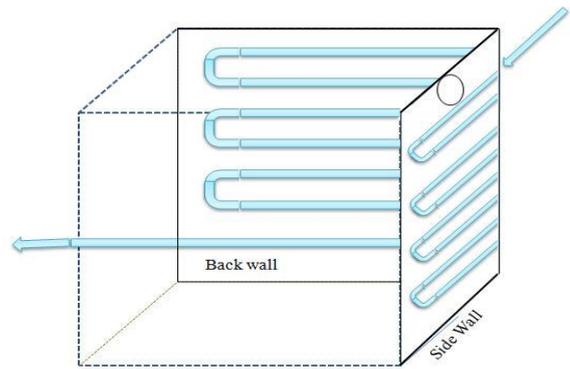


Figure 2: Circulation of pipe on the wall

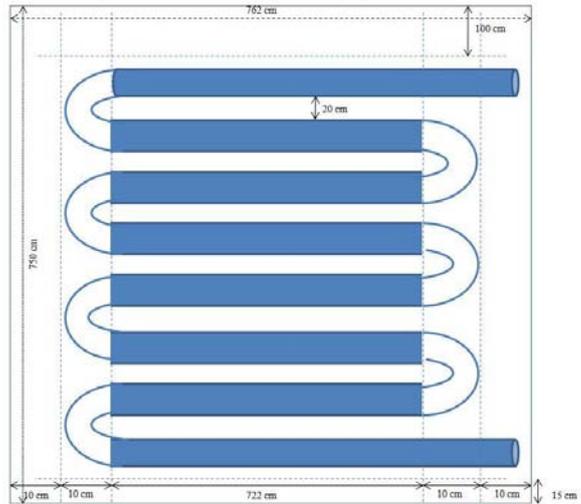


Figure 3: Position of GHE in wall

A various number of parameters have an influence on the ground heat exchanger performance, especially the GHE length and the rate of flow.

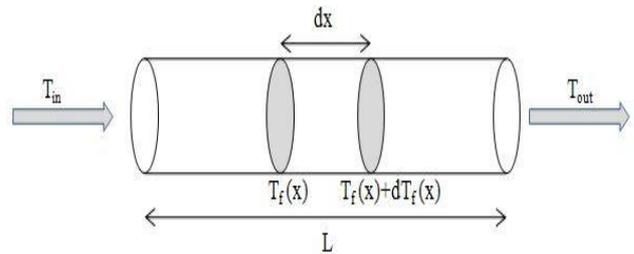


Figure 4: Diagram of Heat Exchanger Pipe

In the analytical model we will thus consider only the heat exchange which is done in fixed system. The heat exchange rate within the pipe is made by forced convection. We consider an infinitesimal element dx of a pipe in the coolant flow in figure (4).

The experimental heat exchange rate is calculated by the following equation

$$Q = m \times c_p \times (T_{out} - T_{in}) \dots\dots\dots (1)$$

The system estimating cooling load of any building there are some basic information necessary to design an exact HVAC systems, like building orientation, weather condition, building spacing, buildings resources etc. The more accurate the information will be the load estimated. Considered a

conference hall for analysis, which is positioned in the multi-story building (Case: Nagar Nigam Raipur) situated in Raipur and located at 81.63° E longitude and 21.23° N latitude in Raipur District of Chhattisgarh, India at an elevation of about 296 meters above mean sea level.

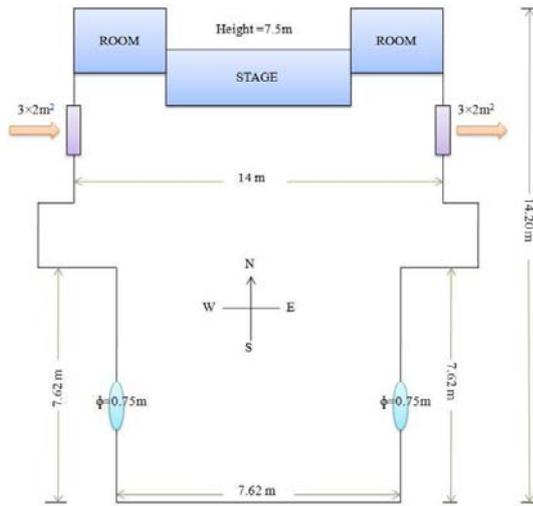


Figure 5: Layout of Nagar Nigam

Conference Hall

Raipur has a “ tropical Hot and dried out weather” temperature remain reasonable all through the year ,except from March to June ,which can be extremely hot .The temperature in April–June sometimes raise above the 46 °C .These summer month also have hot and dry wind, in the summer the temperature may also cross the 48 °C. The average rain fall in the Raipur city is 1300 mm mostly in the Monsoon season from late June to early October. Winter last from November to January.

3. Problem Identification

The objective of this work is to calculate cooling load for a known condition space & another problems are identified are follows:

- 1)To form the basis for building energy analysis.
- 2)Optimization of Mass flow rate for water for building cooling.
- 3)Outcome on cooling rate due to circulation of pipe arrangement.
- 4)Effect on cooling rate on the variation of elevation of the structure.
- 5)To apply the GSHP system on a building in Tropical condition for cooling purpose.
- 6)Determination of reducing in cooling load due to proposed Ground water heat pump system.
- 7)Analysis of reduction of CO2 emission to the atmosphere by using proposed Ground source heat pump.
- 8)To determine the payback period of the system.

4. Equation

To design of any apparatus there is need of various parameters. And for this system essential parameters are mass flow rate, velocity of fluid, discharge, length of pipe,

diameter of pipe, Reynolds no., friction factor, etc. The governing equations for the ground water heat exchanger are given below:

Selection of suitable mass flow rate

$$m = \rho_w \times A_p \times V \dots\dots\dots (2)$$

Where,

- \dot{m} = mass flow rate (kg/s)
- ρ_w = density of water (kg/m³)
- A_p = cross section area of pipe (m²)
- V = velocity of water in pipe (m/s)

Determination of Reynolds Number

$$Re = \frac{Vd}{\nu} \dots\dots\dots (3)$$

Where,

- d_i = Inner diameter of pipe (m)
- d_o = outer diameter of pipe (m)
- ν = kinematic viscosity of water at 25 °C

Calculation of inside heat transfer coefficient

$$Nu = \frac{h_i d_i}{k_w} \dots\dots\dots (4)$$

h_i = Convective heat transfer coefficient at inside the pipe (W/m²K)

k_w = thermal conductivity of water at 25 °C

Calculation of overall heat transfer coefficient

$$U = \frac{1}{\frac{1}{h_o} + \frac{x_p}{k_p} + \frac{r_o}{k_{pipe}} + \ln \frac{r_o}{r_i} + \frac{r_o}{h_i r_i}} \dots\dots\dots (5)$$

Where,

- U = overall heat transfer coefficient (W/m²K)
- x_p = thickness of plaster (m)
- k_p = thermal conductivity of pipe (W/mK)
- h_o = Convective heat transfer coefficient at outside the pipe (W/m²K)

Calculation of Heat transfer rate

$$Q = \dot{m} \times c_{pw} \times (T_{out}-T_{in}) \dots\dots\dots (6)$$

Where,

- Q = heat transfer rate (Watt)
- c_{pw} = specific heat of water at constant pressure (kJ/kgK)
- T_{out} = outlet fluid temperature from heat exchanger (°C)
- T_{in} = inlet fluid temperature to heat exchanger (°C)

Requirement of Pump Power

Power of centrifugal pump is given by the following equation:

$$\text{Power} = \dot{m}gH \dots\dots\dots (7)$$

Where,

- g = acceleration due to gravity (m/sec²)
- H = head against pump is working (m)

Head calculation of Centrifugal pump

$$H = h_s + h_d + h_{fs} + h_{fd} \dots\dots\dots (8)$$

Where,

- h_s = loss of head in suction pipe (m)
- h_d = loss of head in delivery pipe (m)
- loss of head due to friction in suction pipe (m)

$$h_{fs} = \frac{4f_l V^2}{2gd_i} \dots\dots\dots (9)$$

Load calculation for the various sources mention in the equation [] are given below in tables with month wise.

loss of head due to friction in delivery pipe (m) =

$$h_{fd} = \frac{4f_d V^2}{2gd_i} \dots\dots\dots (10)$$

f = coefficient of friction

5. Calculation

The general step by step procedures for Heat Transfer Analysis are as follows: Select inside design condition (Temperature, relative humidity). Select outside design condition (Temperature, relative humidity). Determine the overall heat transfer coefficient U for wall, and roof. Calculate area of wall, ceiling, floor, door, windows. Calculate heat gain from transmission. Calculate solar heat gain. Calculate sensible and latent heat gain from ventilation, infiltration and occupants. Calculate lighting heat gain. Calculation of Total Heat Gain. Calculation of TR.

Hand calculations were done for a small portion of the building. In the Nagar Nigam Conference Hall is treated as separate system. All equations required for heat transfer through the building and for the indoor condition were used to get the thermal load. Then, all the equations were insert in a particular program MS Excel, to get the results.

$$Q_{Total} = Q_{Fabric} + Q_{Infiltration} + Q_{Ventilation} + Q_{Electrical} + Q_{Occupant}$$

Table 1: Heat gain through the Walls & Roof in kW

S.N.	Months	Wall Facing				Roof
		N	E	S	W	
1	March	0.48	0.45	0.37	0.37	19.73
2	April	0.51	0.47	0.39	0.38	20.08
3	May	0.57	0.50	0.42	0.42	20.78
4	June	0.63	0.53	0.45	0.45	21.48

Table 2: Heat gain due to infiltration & Ventilation in kW

S.N.	Months	Infiltration		Ventilation	
		QI	Qs	QI	Qs
1	March	12.73	10.67	7.17	6.01
2	April	11.91	11.43	6.71	6.44
3	May	15.62	12.95	8.80	7.30
4	June	24.23	14.48	13.65	8.16

Table 3: Heat gain through electrical & occupants in kW

S.N.	Months	Electrical	Occupants	
		Q	QI	Qs
1	March	3.69	3.02	3.99
2	April	3.69	3.02	3.99
3	May	3.69	3.02	3.99
4	June	3.69	3.02	3.99

From the above table total cooling load for conference hall is given below in table (4)

Table 4: Total cooling load in kW

S.N.	Months	Fabric	Infiltration	Ventilation	Electrical	occupants	Total
1	March	21.40	23.40	13.18	3.69	7.01	68.68
2	April	21.83	23.34	13.15	3.69	7.01	69.02
3	May	22.69	28.57	16.10	3.69	7.01	78.06
4	June	23.54	38.71	21.81	3.69	7.01	94.76

From the table (4) total cooling load is calculated 27 TR.

6. Results and Conclusion

The deviation of heat gain between results obtained from two different i.e. CLTD method and HAP program methods are shown in Figure [6] It shows that there are little different between two methods and result are satisfactory as ASHRAE standards. To establish the cooling power, a various parameters need to be recognized in order to achieve the analysis. These important parameters are the Cooling load (Q), Working hour of system, COP of the system, Inlet Temperature of ground water, Outlet temperature of water through the heat exchange, Heat transfer between the conditioned space, atmospheric climatic condition. In this study only theoretical analysis will be provided. In order to determine the reduction in consumption of cooling power by installation of Ground water heat exchanger, the number of air conditioner can be reduced and due to reduction of air conditioner directly the reduction of CO₂ emission can be calculated. As there should be prior information of some parameter (like Ground water temperature, ambient temperature, COP of air conditioner) and some derived

parameter (i.e. Heat transfer through the space to the ground water, Cooling load) are to be find out in the previous chapter.

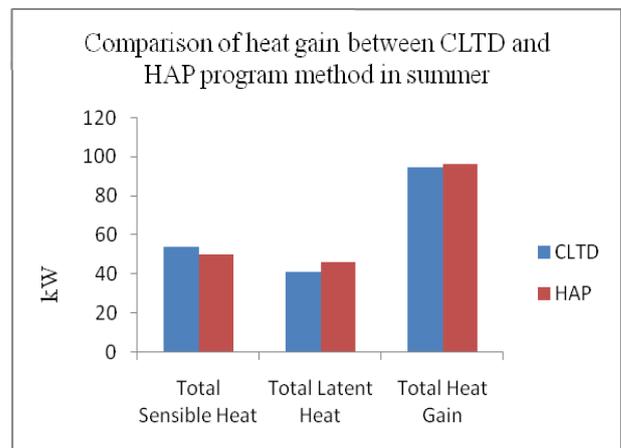


Figure 6: Variation of heat gain between CLTD and HAP program

The climate of Raipur is tropical. It is hot and humid because of its proximity to the Tropic of Cancer, temperatures remain

moderate throughout the year, except from March to June, which can be exceptionally hot. The temperature in April–May at times rises above 48 °C. In summers, the temperature can also go up to 48 °C. Hence needs of space cooling in the summer months and proposed system is suggested for Raipur city. The results conclude that the total cooling load for the Nagar Nigam, conference hall is 27 tons for summer (May to June), which is approximately same, comparing with the AC required tonnage calculated by HAP 4.50 software.

The Ground Water Heat Exchanger is an open type system. It is circulated ground water to building wall through the pipe and remove heat about 14 kW from the conditioned space. Various parameters are analyzed in MAT Lab; the feasible values are shown in table 6.1 that obtained by maintaining rate of flow at 0.7 kg/s for the room temperature according to human comfort.

Table 5: Various parameters and their values

S.N.	Parameters	Values obtained
1	Mass flow rate (m)	0.7 kg/s
2	Velocity of flow (V)	1.38 m/s
3.	Time of each circulation (t)	5.1 min/circulation
4	Outlet temperature of fluid in pipe (T _{out})	29.8 °C
5	Total head of pump (H)	113m
6	Power required (P)	1.5 HP for better functioning

Energy saving per annum for Raipur city has been found 3605 kWh at consideration size of space 1491 m³.

By electricity saving of 3506 kWh, the saving of coal is 3506kg that leads to reduction in CO₂ emission of 9950 kg per year for the same space.

With the annual saving of Rs 21630, the reimbursement time of the Ground Source Heat Pump system has been calculated as 5.03 years for the 4 month working in a year.

References

[1] Heinz Brandl, Thermo-Active Ground-Source Structures for Heating and cooling, (Structures and Techniques), (2013).

[2] HuaQian, YungangWang, Modeling the interactions between the performance of ground source heat pumps and soil temperature variations, (Energy for Sustainable Development), (8 August 2014).

[3] Justin Tamasauska,, Martin Kegel, Roberto Sunye, An analysis of solar thermal technologies integrated into a Canadian office building, (International Conference on Solar Heating and Cooling for Buildings and Industry), (23-25 September 2013).

[4] M.E. Suryatriyastuti, H. Mroueh, S. Burlon, Understanding the temperature-induced mechanical behavior of energy pile foundations (Renewable and Sustainable Energy Reviews), (20 February 2012).

[5] Na Zhu, Pingfang Hu, LinghongXu, Zhangning Jiang, Fei Lei, Recent research and applications of ground source heat pump integrated with thermal energy storage systems: a review, (Applied Thermal Engineering), (21

June 2014).

[6] C.K. Lee, H.N. Lam, A simplified model of energy pile for ground-source heat pump Systems, (Energy), (10 March 2013).

[7] Monique de Moel , Peter M. Bach , Technological advances and applications of geothermal energy pile foundations and their feasibility in Australia, (Renewable and Sustainable Energy Reviews),(15 July 2010).

[8] Christopher J. Wood, Hao Liu, Saffa B. Riffat, An investigation of the heat pump performance and ground temperature of a piled foundation heat exchanger system for a residential building, (Energy), (19 August 2010).

[9] Kulkarni K., P.K. Sahoo and Mishra M., “Optimization of cooling load for a lecture theatre in a composite climate in India” Energy and Buildings, 2011; 43; 1573-1579.

[10] Andersson,B., Wayne P. and Ronald K., " The impact of building orientation on residential heating and cooling" , Energy and Buildings,1985; 8; 205-224.

[11] Al-Rabghi,O. and Khalid A. , " Utilizing transfer function method for hourly cooling load calculations" Energy Conversion and Management,1997; 38; 319-332.

[12] Suziyana M. D., Nina S. N., Yusof T. M. and. Basirul A. A. S., “Analysis of Heat Gain in Computer Laboratory and Excellent Centre by using CLTD/CLF/SCL Method” Procedia Engineering, 2013; 53; 655 – 664.

[13] Hani H. Sait, “Estimated Thermal Load and Selecting of Suitable Air-Conditioning Systems for a Three Story Educational Building” Procedia Computer Science, 2013; 19; 636 – 645.

[14] Foudaa A., Melikyan Z., Mohamed M.A. and Elattar H.F., “A modified method of calculating the heating load for residential buildings” Energy and Buildings, 2014; 75; 170–175.

[15] Duanmu L., Wang Z., ZhaiZ.andXiangli L., “A simplified method to predict hourly building cooling load for urban energy planning” Energy and Buildings, 2013; 58; 281–291.

[16] Christian A., Gueymard and Thevenard D., “Monthly average clear-sky broadband irradiance database for worldwide solar heat gain and building cooling load calculations” Solar Energy, 2009; 83; 1998–2018.

[17] Westphal,F.S. and Roberto L., “The use of simplified weather data to estimate thermal loads of non-residential buildings” Energy and Buildings, 2004; 36; 847-854.

[18] Mui K.W. and Wong L.T. “Cooling load calculations in subtropical climate” Building and Environment, 2007; 42; 2498–2504.

[19] Francesco C., Stefano P.C., Marco F. and Bjarne W.O., “Solar radiation and cooling load calculation for radiant systems: Definition and evaluation of the Direct Solar Load” Energy and Buildings 2010; 42; 305–314.

[20] ASHRAE 1997 “Cooling Load Calculations” Chapter 28; 28.1-28.65.