

Performance Analysis of Heat Operated Ejector Refrigeration System with Natural Refrigerants R-717 and Propane

Jitender Kumar¹, Nitin Jain²

¹Maharashi Dayanand University, Rawal Institute of Engineering & Technology, Zakopur Road, Faridabad 121004, India

²Maharashi Dayanand University, Ganga Institute of Technology & Management Kablana,, Jhajjar 1, India

Abstract: In present study a mathematical model is developed in EES software for single phase Ejector Refrigeration System. The model is then used to determine the performance of natural refrigerants R717 and Propane. The ejector cycle of cooling is very much suitable for the applications where large amount of low-grade heat is released in the environment while refrigeration may also be required in the same application, as it is often the case in the chemical and food processing plants and automobiles. Under such circumstances, non-mechanical, thermally activated ejector machines may represent an excellent mean of heat recovery for cooling. For validation of the mathematical / theoretical model, the performance for R11 was simulated on the computer program by varying the evaporator temperature from 277 to 289K, the boiler temperature from 336K to 358K, the condensing temperature from 298 to 303K and by choosing the area ratios (Ar) 4.0, 5.76 and 7.84. The theoretical performance computed using the model is compared with that of experimental data available in the literature. The calculations of the performance of R717 and Propane have been made taking the following operating temperatures.

Keywords: EES, Refrigerant's, Efficiency, Ejector System

1. Introduction

At present most of the conventional cooling and refrigeration systems are based on mechanical vapor compression system. These vapor compression cycles are working on the high-grade mechanical and electrical energy. The high-grade mechanical and electrical energy is generated most of the time by the combustion of fossil fuels and thus contributes to an increase in greenhouse gases and generation of air pollutants. The jet ejector cycle also has the drawback as ejectors are designed to operate at a single optimum point. Deviation from this optimum point results in deterioration of the ejector performance. The diameters and lengths of various parts forming the nozzle, the diffuser and the suction chamber, together with the stream flow rate and properties, define the ejector capacity and performance. The ejector capacity is defined in terms of the flow rates of the motive steam and the entrained vapor. The sum of the motive and entrained vapor mass flow rates gives the mass flow rate of the compressed vapor. As for the ejector performance, it is defined in terms of entrainment, expansion and compression ratios. The entrainment ratio is the flow rate of the entrained vapor divided by the flow rate of the motive steam. The COP of the system can give the overall performance of the ejector system. The effect of various system parameters on COP is studied with the refrigerants R717 and Propane.

2. Thermodynamic Analysis of the Ejector System

A system analysis of ejector refrigeration system is carried out in the present study. Governing equations based on the balance of mass, momentum and energy are derived for components of the system.

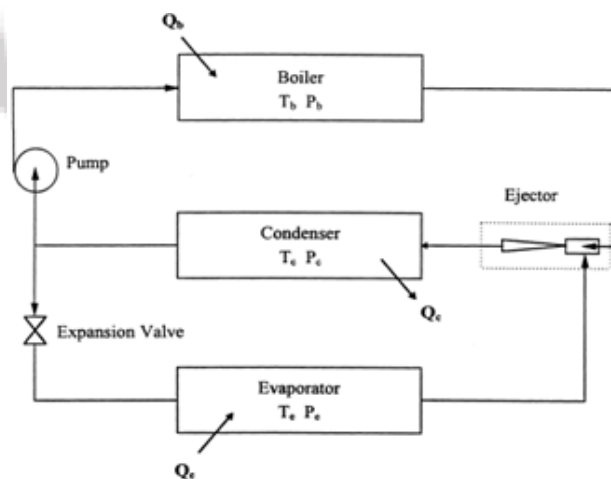


Figure 1: Schematic diagram of Ejector refrigeration system

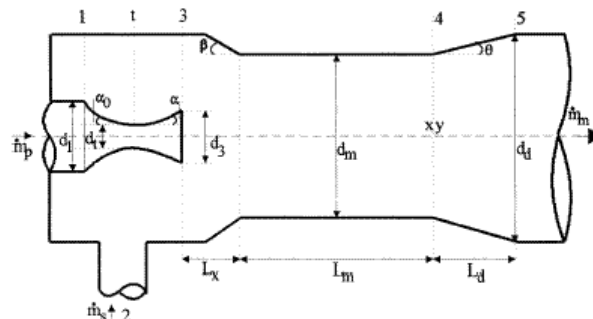


Figure 2: Schematic diagram of Ejector showing various sections

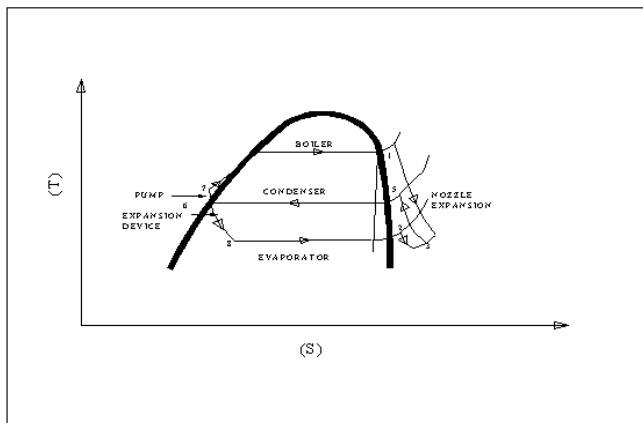


Figure 3: Ejector refrigeration system on T-S diagram

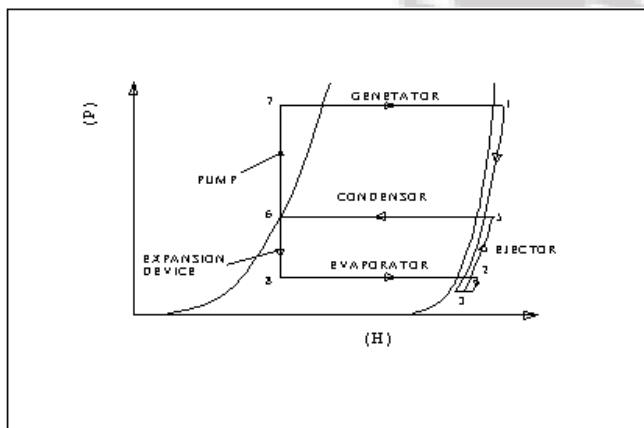


Figure 4: Ejector refrigeration system on P-H diagram

Assumptions made for analysis

1. The refrigerant was at all times in thermodynamic quasi-equilibrium.
2. Characteristics and velocities were constant over cross section (one-dimensional model of flow).
3. All fluid characteristics are uniform over the cross section after complete mixing at the exit of the mixing tube.
4. There is no external heat transfer.
5. Mixing occurs at constant pressure in the ejector-mixing region with the assumption that the fluid momentum is conserved.

The condition of the fluid at various sections of ejector:

Boiler side entry: - T_b ; $V_b=0$ and P_b, H_b, S_b , are for saturated vapor at T_b
 Evaporator side entry: - T_e ; $V_e=0$ and P_e, H_e, S_e , are for saturated vapor at T_e
 Exit of primary nozzle: -
 Primary fluid: - P_{p3}, V_{p3}, H_{p3} (after expansion through nozzle)
 Suction fluid: - P_{s3}, V_{s3}, H_{s3} (after suction, applying choking condition)
 After mixing in mixing tube: - P_m, V_m, H_m
 After normal shock: - P_y, V_y, H_y
 Exit of diffuser: - P_d, V_d, H_d

2.1 Computational procedure

The flow diagram in the figure indicates the brief logical procedure of the solution of above thermal analysis of

ejector. For the given ejector geometry and the given operating conditions T_b, T_c, T_e and P_b, P_c, P_e the above equations are solved by the prepared software. The choking condition applied to the suction fluid at the entrance of the mixing chamber, the pressure at the choking point P_{s3} is determined through critical pressure ratio. Considering assumption of uniform pressure mixing the exit pressure of primary and suction fluid is also taken same, $P_{p3}=P_{s3}$. By the exit pressure and efficiencies of the nozzle flow, the condition of both primary and suction fluid is determined.

The efficiencies of the Ejector:

Primary nozzle Efficiency =95%

Suction Nozzle Efficiency =95%

Diffuser Efficiency: =95%

The refrigerants taken for study:

For validation of the program calculations: - R11

For performance analysis: - R717 and Propane

The temperature parameters for study:

Boiler temperatures: - $T_b = 333K, 343K,$ and $353K,$

Condenser temperatures: - $T_c = 298K$ to $313K$ in steps of $5K$

Evaporator temperatures: - $T_e = 268K$ to $278K$ in steps of $1K$

3. Results and Discussion

Reference calculations

For validation of the program w.r.t R11 and R717

For validation of the mathematical / theoretical model, the performance for R11 was simulated on the computer program by varying the evaporator temperature from 277 to $289K$, the boiler temperature from $336K$ to $358K$, the condensing temperature from 298 to $303K$ and by choosing the area ratios (A_r) $4.0, 5.76$ and 7.84 . The theoretical performance computed using the model is compared with that of experimental data available in the work of Cizungu et al. (2001).

Performance of R717 with Ejector of $A_r=4.0$

For boiler temperature $T_b=333K$ the COP of the system is varying from 0.06 to 0.34 for $T_c= 298K$ and 0.01 to 0.14 for $T_c=303$. At these parameters the COP increases with increase in evaporator temperature or compression ratio. For condenser temperature $303K$ the COP values are low as given above, and if the condenser temperature further increased, COP becomes zero.

Performance of R717 with Ejector of $A_r=5.76$

For boiler temperature $T_b=333K$ the COP of the system, at $T_c=298K$ is 0.03 to 0.28 and at $T_c=303K$ is less than 0.1 . At these parameters the COP increases with increase in evaporator temperature or compression ratio. For condenser temperature $T_c=308K$ and more the COP becomes zero.

Performance of R717 with Ejector of $A_r=7.84$

For boiler temperature $T_b=333K$ the COP of the system, at $T_c=298K$ is 0.02 to 0.27 and at $T_c=303K$ is less than 0.1 . For condenser temperature $T_c=308K$ and $313K$ the COP becomes zero.

4. Result Discussion with Propane

Performance of Propane with Ejector of Ar=4.0

For boiler temperature $T_b=333K$ the COP of the system is varying from 0.08 to 0.37. For condenser temperature $T_c=303K$ the COP values are varying from 0.001 to 0.18. The COP values are less than 0.05 for $T_c=308K$ and if the condenser temperature further increased, COP becomes zero.

Performance of Propane with Ejector of Ar=5.76

For boiler temperature $T_b=333K$ the COP of the system, at $T_c=298K$ is 0.07 to 0.38, at $T_c=303K$ is 0.01 to 0.18, and less than 0.1 at $T_c=308K$,

Performance of Propane with Ejector of Ar=7.84

For boiler temperature $T_b=333K$ the COP of the system, at $T_c=298K$ is 0.1 to 0.57, at $T_c=303K$ is 0.005 to 0.31, and at $T_c=308K$ is 0.02 to 0.14. If the condenser temperature further increased, COP becomes zero.

4.1 Performance Comparison R717 and Propane Comparison for Area Ratio Ar=4

The COP of the R717 is more than Propane, for $T_b=333K$, $T_c=303K$ (0.04 to 0.15 more), and for $T_b=353K$, $T_c=298K$ (0.01 to 0.025 more). For all other parameters the COP of propane is more, but not having much difference and it is almost same for $T_b=343K$, $T_c=298K$ and $T_b=353K$, $T_c=303K$. For this area ratio the COP is not having much difference.

Comparison for Area Ratio Ar=5.76

The COP of propane is again more for the combinations of T_b , T_c : 333K, 298K (0.05 to 0.1 more); 333K, 303K (0.06 to 0.08 more); 343K, 303K (0.04 more); 353K, 308K (0.03 more). The COP is not significant difference for T_b , T_c : (343K, 298K; 353K, 298K; 353K, 303K). The difference in COP of the refrigerants is less for combination of high boiler temperature and low condenser temperatures. For low boiler temperatures and high condenser temperatures the COP of propane difference is more.

Comparison for Area Ratio Ar=7.84

For this ejector configuration at $T_b=353K$ and $T_c=298K$ the COP of propane is more than R717 but difference is small (0.02 to 0.05). For all other combinations of the parameters under study the COP of Propane is higher than the R717 and difference varies as, at T_b , T_c : 333K, 298K (0.08 to 0.3 more); 333K, 303K (0.1 to 0.2 more); 343K, 298K (0.05 to 0.1 more); 343K, 303K (0.05 to 0.1 more); 353K, 303K (0.04 to 0.05 more); 353K, 308K (0.04 more),

Performance Comparison with VCRS

From the analysis of the comparison data of Ejector Refrigeration system (ERS) and VCRS, it is observed that the COP of the ERS is not more than the 10% of COP VCRS under the parameters taken for study. Further it also indicates that the COP of ERS is very sensitive to the evaporator and condenser temperature, and its maximum performance is there for some fixed parameters.

5. Conclusion

In present work, the performance analysis of a heat operated ejector refrigeration system is done with natural refrigerants R717 and Propane. The discussion and analysis of the obtained results permit the following remarks:

1. The COP of propane is higher than R-717 for same ejector and temperature parameters.
2. The COP of R-717 is high for area ratio $Ar=4.0$, reduces at $Ar=5.76$ and $Ar=7.84$ by 0.03 to 0.05. The COP at $Ar=5.76$ is more than $Ar=7.84$ by 0.01.
3. The COP of Propane is high for area ratio $Ar=7.84$, reduces at $Ar=5.76$ and $Ar=4.0$ by 0.02 to 0.2. The COP at $Ar=4.0$ is more than $Ar=5.76$ by 0.01.
4. The COP for both, R717 and Propane is high for higher boiler temperature and low condenser temperatures.
5. The COP for both, R717 and Propane with ejector refrigeration system is very sensitive to the change in condenser temperature.
6. The COP for both, R717 and Propane reduces with increase in the boiler or heat source temperature.
7. For low area ratio the COP of Propane and R717 is not having much difference but for high area ratios the propane is better than R717.

6. Scope for Future Work

- Performance analysis of these natural refrigerants with experimental ejector refrigeration system.
- The study for finding out the optimum geometry of the ejector with propane and other natural refrigerants.
- The similar performance analysis can be done with other natural refrigerants like Propylene etc.
- Performance comparison of the ejector refrigeration system with different natural refrigerant.

References

- [1] Aidoun Z. and Ouzzane M.; "The effect of operating conditions on the performance of a supersonic ejector for refrigeration", International Journal of Refrigeration 27 (2004) 974–984 R. Caves, Multinational Enterprise and Economic Analysis, Cambridge University Press, Cambridge, 1982. (book style)
- [2] Chaiwongsa P. and Wongwiset S.; "Effect of throat diameters of the ejector on the performance of the refrigeration cycle using a two-phase ejector as an expansion device", International Journal of Refrigeration xx (2007) 1- 8
- [3] Cizungu K., Mani A. and Groll M., "Performance comparison of vapor jet refrigeration system with environment friendly working fluids", Applied Thermal Engineering 21 (2001) 585-598
- [4] Deng J., Jiang P., Lu T. and Lu W.; "Particular characteristics of transcritical CO2 refrigeration cycle with an ejector", Applied Thermal Engineering 27 (2007) 381–388
- [5] Dessouky H. E., Ettouney H., Alatiqi I. and Al-Nuwaibit G.; "Evaluation of steam jet ejectors",

- Chemical Engineering and Processing 41 (2002) 551–561
- [6] Domanski P. A.; “Theoretical Evaluation of the Vapor Compression Cycle With a Liquid-Line / Suction-Line Heat Exchanger, Economizer, and Ejector”, U.S. Department of Commerce
- [7] Disawas S. and Wongwises S.; “Experimental investigation on the performance of the refrigeration cycle using a two-phase ejector as an expansion device”, International Journal of Refrigeration 27 (2004) 587–594
- [8] Goktun Selahattin, “Performance analysis of a heat engine driven combined vapor compression-absorption-ejector refrigerator”, Energy Conversion & Management 41 (2000) 1885-1895
- [9] Menegay P. and Kornhauser A.A.; “Improvements to the ejector expansion refrigeration cycle”, Department of Mechanical Engineering, MS 0238 Blacksburg, VA 24061, 1996
- [10] Nehdi E., Kairouani L. and Bouzaina M.; “Performance analysis of the vapor compression cycle using ejector as an expander”, Int. J. Energy Res. 2007; 31:364–375
- [11] Ouzzane M. and Aidoun Z.; “Model development and numerical procedure for detailed ejector analysis and design”, Applied Thermal Engineering 23 (2003) 2337–2351
- [12] Sun D. W.; “Solar powered combined ejector – vapor compression cycle for air conditioning and refrigeration”, Energy Converse. Mgmt Vol. 38, No. 5, pp. 479-491, 1997
- [13] Sun D. W.; “Solar powered combined ejector – vapor compression cycle for air conditioning and refrigeration”, Energy Converse. Mgmt Vol. 38, No. 5, pp. 479-491, 1997
- [14] Sun D. W.; “Variable geometry ejectors and their application in ejector refrigeration system”, Energy Vol. 21, No. 10. PP. 919-929, 1996
- [15] Sun D. W.; “Comparative study of the performance of an ejector refrigeration cycle operating with various refrigerants”, Energy Conversion & Management 40 (1999) 873-884
- [16] Wongwises S. and Disawas S.; “Performance of the two-phase ejector expansion refrigeration cycle”, King Mongkut s University of Technology Thonburi, Bangmod, Bangkok, 2005

Author Profile

Jitender Kumar received the B.Tech degree in Mechanical Engineering from Punjab College of Engineering and Technology in 2010 of India. He is pursuing M.Tech degree from Rawal Institute of Engineering & Technology (M.Tech scholar in 2013) of India to study different thermodynamics process and analysis during his M.Tech degree.