

# Voltage and Frequency Control of Asynchronous Generator for an Isolated Wind Energy Conversion System

Pranay Bhadauria<sup>1</sup>, Mohd. Ilyas<sup>2</sup>

<sup>1</sup>M. Tech Scholar (Power System)  
Department of Electrical & Electronics Engineering  
AFSET (An Autonomous Institution)  
Dhauj Faridabad Haryana Pin -121004  
[pranayesp4u@gmail.com](mailto:pranayesp4u@gmail.com)

<sup>2</sup>Assistant Professor  
Department of Electrical & Electronics Engineering  
AFSET (An Autonomous Institution)  
Dhauj Faridabad Haryana Pin -121004  
[mohdilyas33@yahoo.com](mailto:mohdilyas33@yahoo.com)

**Abstract:** *This paper deals with a battery energy storage system (BESS) and an IGBT (Insulated Gate Bipolar Junction Transistor) based 4 leg voltage source converters. Three legs of the converter are connected to each phase of the generator while the fourth leg is used to compensate the source neutral current. A star connected three phase capacitor bank is used for the generator excitation and the value of the excitation capacitor is selected to generate the rated voltage at no load. The proposed controller is having capability for harmonic elimination, load balancing, bidirectional flow capability of active power and reactive power by which it can control the system voltage and frequency with variation of consumer loads and the speed of the wind. The proposed generating system is modeled and simulated in MATLAB along with Simulink and power system blockset (PSB) toolboxes. The simulated results are presented to demonstrate the capability of an isolated generating system for feeding three-phase four-wire loads with the neutral current compensation.*

**Keywords:** Asynchronous generator, BESS, isolated generating system, neutral current compensations

## 1. Introduction

The increasing interest in renewable energy sources, simple constructible machine (Induction Generator), power quality improvement, uncertainty in power output, isolated system integration, induction generator poor voltage regulation, induction generator reactive power requirement, and uncertainty in consumer load give attention to power engineer about the maximum power tracking, reactive power supply of generator, interconnection of network, voltage and frequency control of load and storage of power. Also ancillary services, power system restructuring constraint give more attention to think about load and frequency control system with proper control strategy [1],[3]. On view of these here we are selecting proposed load and frequency control system. Renewable energy sources have attracted attention worldwide due to soaring prices of fossil fuels. Renewable energy sources are considered to be important in improving the security of energy supplies by decreasing the dependency on fossil fuels and in reducing the emissions of greenhouse gases (GHG). The viability of isolated systems using renewable energy sources depends largely on regulations and stimulation measures. Renewable energy sources are the natural energy resources that are inexhaustible: for example, wind, solar, geothermal, biomass and small-hydro generation [2]. Amongst renewable energy sources, small-hydro and wind energy have ability to complement each other [2]. For power generation by small or micro-hydro as well as wind systems, the use of squirrel cage induction generators (SCIGs) has been reported in literature [4]-[16].

Although the potential for small hydroelectric systems depends on the availability of suitable water flow, where the resource exists it can provide cheap, clean, reliable electricity [6]. Hydroelectric plants convert the kinetic energy of a waterfall into electric energy. The power available in a flow of water depends on the vertical distance the water falls (i.e., head) and the volume of flow of water in unit time (i.e., discharge). The water powers a turbine, and its rotation movement is transferred through a shaft to an electric generator [7]. When SCIG is used for small wind power applications, its reactive power requirement is met by a capacitor bank at its stator terminals [8]. The SCIG has advantages like simplicity, low cost, rugged, maintenance free, absence of DC, brushless etc. [7].

As regards wind turbine-generators, these can be built either as constant-speed machines, which rotate at a fixed speed regardless of wind speed, or as variable-speed machines in which rotational speed varies in accordance with wind speed. For fixed speed wind turbines, energy conversion efficiency is very low for widely varying wind speeds. In recent years, wind turbine technology has switched from fixed-speed to variable-speed. The variable speed machines have several advantages. They reduce mechanical stresses, dynamically compensate for torque and power pulsations, improve power quality, and system efficiency [7]. The grid connected variable speed wind energy conversion system based on SCIG use back to back connected power converters [9]. In such systems, the power converter decouples the SCIG from the grid, resulting in an improved reliability. Flux oriented control of induction generator has been demonstrated in [9] as vector control of induction

generator for wind power. Voltage and frequency control of load has been reported by different way [11, 12 and 13]. Battery based load voltage and frequency controller has been given in [17, 18 and 19]. Self excitation capacitance calculation has been reported in [5, and 6]. Charging battery mathematical model has been demonstrated in [14, and 15]. Electronic load voltage controller by IGBT has been reported in [3]. Proposed electronic load controller acts as a reactive power controller, load balancer and load controller.

**2. System configuration and control scheme**

Figure 1 & Figure 2 shows the system configuration and a control strategy of an asynchronous generator. The control scheme of the STATCOM to regulate the terminal voltage of the generator is based on the generation of reference source currents, which have two components, in-phase and quadrature, with the ac voltage. The in-phase unit templates (Ua, Ub and Uc) are three-phase sinusoidal functions, computed by dividing the ac voltages (Vla, Vlb and Vlc) by their amplitude. Another set of quadrature unit templates (Wa, Wb and Wc) are sinusoidal functions obtained from in-phase templates ( Ua, Ub and Uc). To regulate the ac terminal voltage Vtm , it is sensed and compared with the reference voltage. The voltage error is processed in the proportional integral (PI) controller.

The output of the PI controller ( $i_{smq}^r$ ) for an ac voltage control loop decides the amplitude of reactive current to be generated by the STATCOM. Multiplication of quadrature unit templates (Wa, Wb and Wc) with the output of the PI-

based ac voltage controller  $i_{smq}^r$  yields the quadrature component of the reference source currents ( $i_{saw}^r, i_{sbw}^r$  and  $i_{scw}^r$ ). The amplitude of active power component of the source current (Idm) is estimated by dividing the difference of filtered load power (PLfilter) and output of PI frequency controller (Pc) to the amplitude of the terminal voltage (Vtm). Multiplication of Idm with in-phase unit templates (Ua, Ub and Uc) yields the in-phase component of reference source currents. The instantaneous sum of quadrature and in-phase components provides the reference source currents ( $i_{sa}^r, i_{sb}^r$  and  $i_{sc}^r$ ), which are compared with the sensed line currents ( $i_{sa}, i_{sb}$  and  $i_{sc}$ ). These current error signals are amplified and compared with the hysteresis controller to generate the gating signals for IGBTs of the VSC. Fourth leg of the STATCOM is used to compensate the source neutral current ( $i_{sn}$ ) that is maintained at zero reference value ( $i_{sn}^r$ ) through switching of the IGBTs of this leg.

**3. Control algorithm**

Basic equations of the control scheme of the proposed controller for an asynchronous generator are developed in this section.

**3.1 Control Algorithm for the STATCOM**

Different components of the STATCOM used in asynchronous generator-system shown in Figure 1 & Figure 2 are modeled as follows.

Three line voltages at the generator terminals (Vla, Vlb and Vlc) are considered sinusoidal, and hence their amplitude is computed as

$$V_{tm} = \{(2/3)(V_{la}^2 + V_{lb}^2 + V_{lc}^2)\}^{1/2}$$

The unit template in phase with (Vla, Vlb and Vlc) are derived as

$$U_a = V_{la} / V_{tm}; U_b = V_{lb} / V_{tm}; U_c = V_{lc} / V_{tm}$$

The unit template in quadrature with (Vla, Vlb and Vlc) may be derived using a quadrature transformation of the in-phase unit template ( Ua, Ub and Uc) as

$$\begin{aligned} W_a &= -U_b / \sqrt{3} + U_c / \sqrt{3} \\ W_b &= \sqrt{3}U_a / 2 + (U_b - U_c) / 2\sqrt{3} \\ W_c &= -\sqrt{3}U_a / 2 + (U_b - U_c) / 2\sqrt{3} \end{aligned}$$

**3.1.1 Quadrature Component of Reference Source Currents**

The ac voltage error  $V_{er(n)}$  at the nth sampling instant is

$$V_{er(n)} = V_{tref(n)} - V_{t(n)}$$

where  $V_{tref(n)}$  is the amplitude of reference ac terminal voltage and  $V_{t(n)}$  is the amplitude of the sensed three-phase ac voltage at the generator terminals at nth instant.

The output of the PI controller ( $i_{smq(n)}^r$ ) for maintaining the ac terminal voltage constant at the nth sampling instant is expressed as

$$i_{smq(n)}^r = i_{smq(n-1)}^r + K_{pa}\{V_{er(n)} - V_{er(n-1)}\} + K_{ia}V_{er(n)}$$

where  $K_{pa}$  and  $K_{ia}$  are the proportional and integral gain constants of the PI controller.  $V_{er(n)}$  and  $V_{er(n-1)}$  are the voltage errors in nth and (n-1)th instants and  $i_{smq(n-1)}^r$  is the amplitude of quadrature component of the reference source current at (n-1)th instant.

The quadrature components of reference source currents are computed as

$$i_{saw}^r = i_{smq}^r \cdot W_a; i_{sbw}^r = i_{smq}^r \cdot W_b; i_{scw}^r = i_{smq}^r \cdot W_c$$

**3.1.2 In Phase Component of Reference Source Currents**

Active component of reference source current is estimated by dividing the difference of filtered instantaneous load

power (PLfilter) and output of the PI frequency controller to the terminal voltage  $V_{tm}$ . The load power  $P_L$  is estimated as by taking three phases to two phase transmitter.

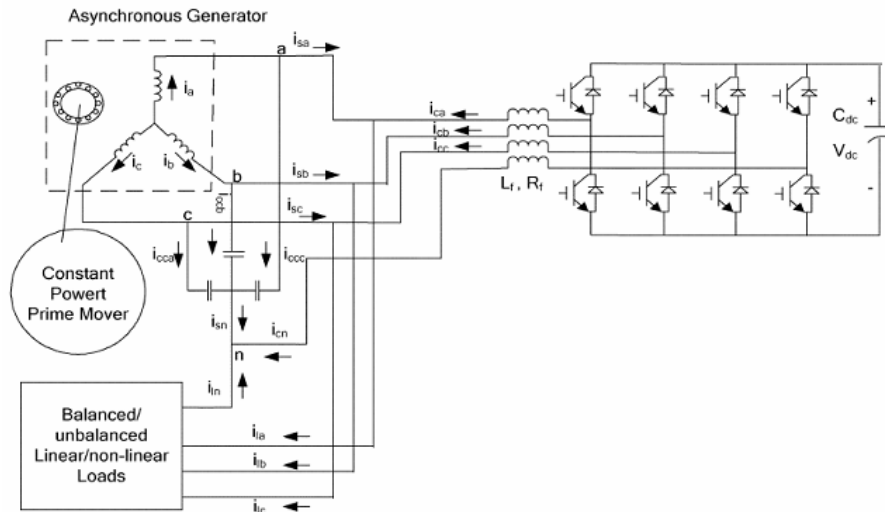


Figure 1: Schematic diagram of BESS based VF controller for isolated wind energy conversion system

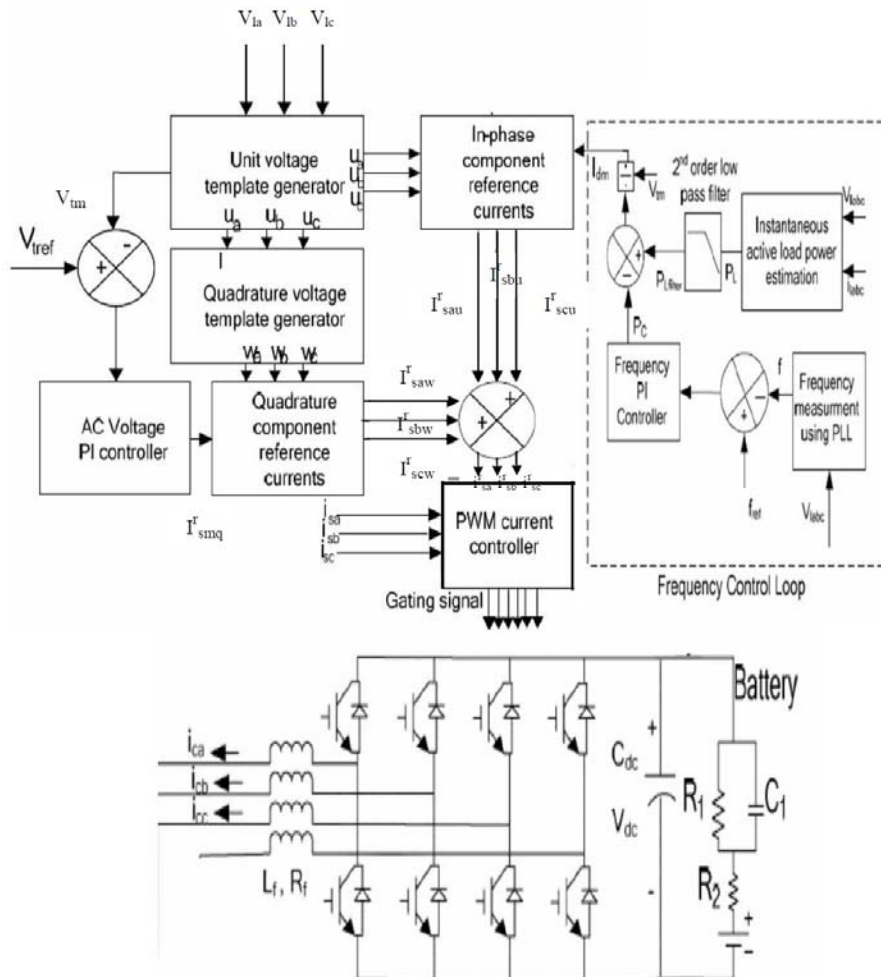


Figure 2: Schematic diagram of control scheme for VSC based VF Controller

$$V_1 = (\sqrt{2/3})(V_{la} - 1/2V_{lb} - 1/2V_{lc})$$

$$V_2 = (\sqrt{2/3})(\sqrt{3/2}V_{lb} - \sqrt{3/2}V_{lc})$$

$$i_1 = (\sqrt{2/3})(i_{la} - 1/2i_{lb} - 1/2i_{lc})$$

$$i_2 = (\sqrt{2/3})(\sqrt{3/2}i_{lb} - \sqrt{3/2}i_{lc})$$

Instantaneous active power is estimated as

$$PL = V1i1 + V2i2$$

It is filtered to achieve its DC component (PLfilter).

Then active component of reference source current Idm is calculated as

$$Idm = 2(PLfilter - Pc) / (3Vtm)$$

The instantaneous line voltage is at the terminal of an asynchronous generator (Vla, Vlb and Vlc) are considered sinusoidal and their amplitude is computed as

$$V_{lm} = \{(2/3)(V_{la}^2 + V_{lb}^2 + V_{lc}^2)\}^{1/2}$$

The unity amplitude templates are having instantaneous value in phase with instantaneous voltage (Vla, Vlb and Vlc) which are derived as

$$U_a = V_{la} / V_{lm}; U_b = V_{lb} / V_{lm}; U_c = V_{lc} / V_{lm}$$

Instantaneous values of in phase component of reference source currents are estimated as

$$i'_{sau} = I_{dm} U_a; i'_{sbu} = I_{dm} U_b; i'_{scu} = I_{dm} U_c$$

### 3.1.3 Reference Source Currents

Total reference source currents are a sum of in-phase and quadrature components of the reference source currents, as follows:

$$i'_{sa} = i'_{saw} + i'_{sau}$$

$$i'_{sb} = i'_{sbw} + i'_{sbu}$$

$$i'_{sc} = i'_{scw} + i'_{scu}$$

### 3.1.4 Neutral Current Compensation

The fourth leg of the VSC of the STATCOM is used to compensate the source neutral current and is controlled at the reference value ( $i'_{sn}$ ). The source neutral current ( $i_{sn}$ ) which is sum of source phase currents is compared with its reference value ( $i'_{sn}$ ).

$$i'_{sn} = 0; i_{sn} = i_{sa} + i_{sb} + i_{sc}; i_{snerr} = i'_{sn} - i_{sn}$$

The current error signal  $i_{snerr}$  is amplified and compared using a hysteresis current controller for generating the PWM signal for switching of the fourth leg of the VSC. For making source neutral current ( $i_{sn}$ ) "zero", the compensating current should be equal and opposite in direction of sum of load currents.

### 3.1.5 PWM Current Controller

The reference currents ( $i'_{sa}$ ,  $i'_{sb}$  and  $i'_{sc}$ ) are compared with the sensed source currents ( $i_{sa}$ ,  $i_{sb}$  and  $i_{sc}$ ). The ON/OFF switching patterns of the gate drive signals to the IGBTs are generated from the PWM current controller. The current errors are computed as

$$i_{saerr} = i'_{sa} - i_{sa}$$

$$i_{sberr} = i'_{sb} - i_{sb}$$

$$i_{scerr} = i'_{sc} - i_{sc}$$

These current error signals are amplified and then compared in the PWM hysteresis controller for switching of the IGBT of the VSC of the STATCOM.

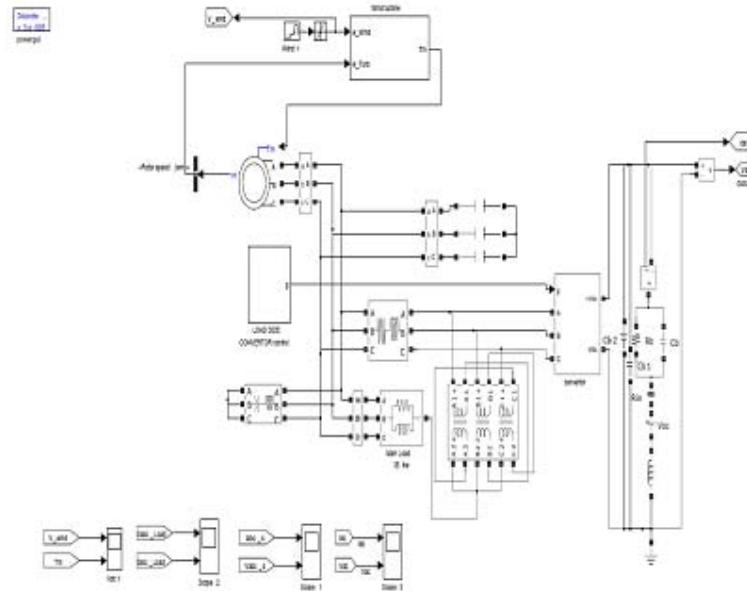


Figure 3: MATLAB Based Simulation model of the asynchronous generator with STATCOM Based VFC.

#### 4. Results and discussion

The performance of the proposed controller is demonstrated under different electrical and mechanical dynamic condition Fig. 4 shows the performance of the controller for supplying balanced / unbalanced non-linear loads under the condition of varying wind speeds and it is observed that in all such conditions the controller response in a desirable manner . Simulated transient wave forms of the generator voltage ( $V_{abc}$ ), generator current ( $i_{abc}$ ), load currents ( $i_{labc}$ ) speed of the wind ( $v_w$ ), battery current ( $i_b$ ), battery voltage ( $v_b$ ) are given in different dynamic conditions.

#### 5. Conclusion

The performance of an isolated asynchronous generator based voltage and frequency controller for isolated wind energy conversion system has been demonstrated for load leveling, voltage and frequency regulation. The proposed controller is having good capability for harmonic elimination, load balancing, and load leveling and voltage and frequency control. MATLAB based simulation results have shown the satisfactory performance for the proposed electrical distribution system feeding linear and non-linear loads.

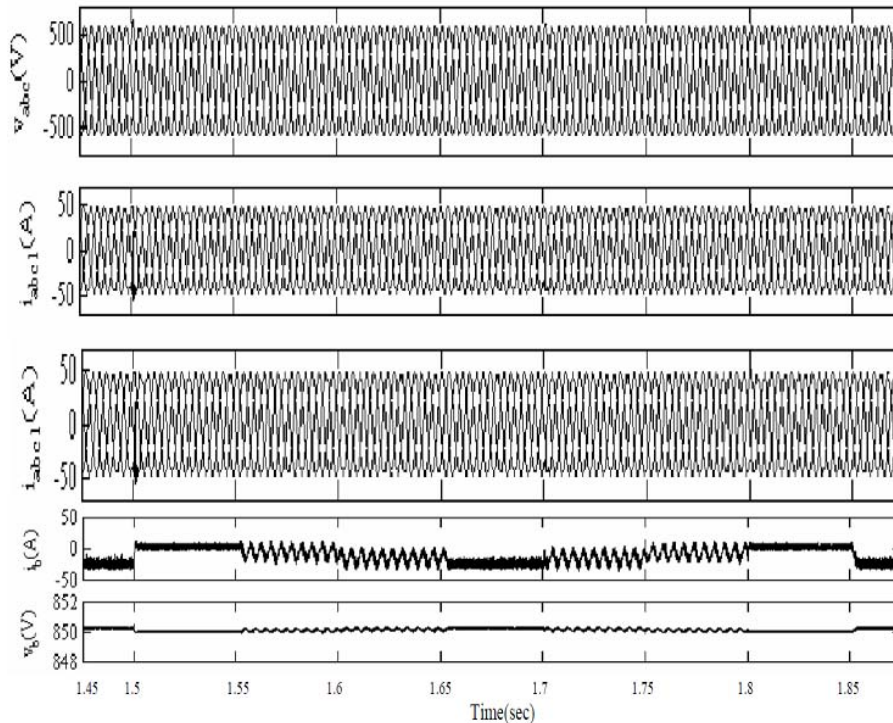


Figure 4: Performance of the controller under the condition of varying wind speed and load

## 6. Appendix

1) Parameters of 40-kW 415-V 50-Hz Y-connected four-pole:

$R_s = 0.09961 \Omega$

$L_s = 0.867 \text{ mH}$

$R_r = 0.058 \Omega$

$L_r = 0.867 \text{ mH}$

$L_m = 0.030369 \text{ H}$

Inertia = 0.4 kg •

2) Parameters of 40-kW wind turbine:

Wind-speed range = 6.0–11.2 m/s

Speed range = 43–81 r/min

$I = 13.5 \text{ kg} \cdot$

$r = 7.5 \text{ m}$

= 0.4412

$\lambda^* = 5.66$

3) PI Controllers: Voltage controller:

= 15

= 0.05.

4) Transformer Specifications:

Three single-phase transformers of 15 kVA 138/138 V, connected in zigzag manner

5) Battery Specifications:

= 43 156 F

= 10 k $\Omega$

= 0.2  $\Omega$

= 750 V

= 680 V

Storage = 600 kW • h

$L = 1 \text{ mH}$ .

## References

- [1] Bimal K. Bose, Power Electronics and Motor Drives: Advances and Trends, Academic Press London, 2006.
- [2] E. D. Castronuovo, J. A. Peps Lopes, Bounding Active Power Generation of a Wind-Hydro Power Plant, 8th International Conference on Probabilistic Methods Applied to Power Systems, Iowa State University, Ames, Iowa, September 12-16, 2004
- [3] Bhim Singh, S.S. Murthy, and Sushma Gupta, Analysis and Design of Electronic Load Controller for Self-Excited Induction Generators, IEEE Transactions on Conversion March 2006.
- [4] L. Shridhar, Bhim Singh, C. S. Jha and B.P. Singh, Analysis of Self Excited Induction Generator Feeding induction motor, IEEE Transactions on Energy Conversion, Vol. 9, No. 2, June 1994
- [5] B. Sawetsakulanond, P. Hothongkham, V. Kinnares, Design and Construction of a Three Phase of Self-Excited Induction Generator, ICSET 2008, pp.1227-1232
- [6] E. Levi, Y.W. Liao, An experimental investigation of self-excitation in capacitor excited induction generators, Electric Power Systems Research 53 (2000) pp.59–65.

- [7] A. Kuperman and R. Rabinovici, On the Speed Stability of Wind Driven Induction Generators Connected to Distribution Systems, International Journal of Energy and Environment, Issue 2, Volume 1, 2007
- [8] D. Seyoum, F. Rahman and C. Grantham, Terminal Voltage Control of a Wind Turbine Driven Isolated Induction Generator.
- [9] Jos´e Luis Dom´inguez-Garc´ia, Oriol Gomis-Bellmunt, Llu´is Trilla-Romero, and Adri`a Junyent-Ferr´ey, Vector Control of Squirrel Cage Induction Generator for Wind Power, XIX International Conference on Electrical Machines - ICEM 2010, Rome
- [10] S.-C.Kuo and L.Wang, Analysis of voltage control for a self-excited induction generator using a current-controlled voltage source inverter (CC-VSI) IEE Proc.-Genes. Transmi. Distrrb. Vol. 148, No. 5, September 2001.
- [11] Gaurav Kumar Kasal and Bhim Singh, Decoupled Voltage and Frequency Controller for Isolated Asynchronous Generators Feeding Three-Phase Four-Wire Loads, IEEE Transactions on Power Delivery, Vol. 23, No. 2, April 2008
- [12] Dheeraj Joshi, Kanwarjit Singh Sandhu, and Mahender Kumar Soni, Constant Voltage Constant Frequency Operation for a Self-Excited Induction Generator IEEE Transactions on Energy Conversion, Vol. 21, No. 1, March 2006
- [13] S.K. Jain, J.D. Sharma and S.P. Singh, Transient performance of three-phase self-excited induction generator during balanced and unbalanced faults, IEE Proc.-Gener. Transm Distrib Vol. 149, No. 1, January 2002
- [14] Ziyad M. Salameh, Margaret A. Casacca, William A. Lynch, A Mathematical Model for Lead-Acid Batteries, IEEE Transactions on Energy Conversion, Vol. 7, No.1, March 1992
- [15] Ravinder Singh Bhatia, S. P. Jain Dinesh Kumar Jain Bhim Singh, Battery Energy Storage System for Power Conditioning of Renewable Energy Sources, IEEE PEDS 2005
- [16] Bhim Singh, Gaurav Kasal, Battery Based Voltage and Frequency Controller for Parallel Operated Isolated Asynchronous Generators, 1-4244-0755-9/07/\$20.00 '2007 IEEE
- [17] Bhim Singh, A. Adya, A.P. Mittal, J.R.P Gupta, Application of Battery Energy Operated System to Isolated Power Distribution Systems, PEDS 2007
- [18] Milton E. de Oliveira Filho, Jonas R. Gazoli, Alfeu J. Sguarezi Filho, Ernesto Ruppert Filho, A Control Method for Voltage Source Inverter Without Dc Link Capacitor, 2008 IEEE
- [19] L. Tamas, Z. Szekeley, Modeling and Simulation of Induction Drive with Application to a Small Wind Turbine Generator, 2008 IEEE

## Author Profile



**Pranay Bhadauria** was born on 5th November 1981, Allahabad, India He received the B. Tech (Electrical & Electronics Engineering) degree from Uttar Pradesh Technical University, Lucknow, India, respectively in 2007. He is currently pursuing the M. Tech degree with the Department of Electrical Engineering, Al-

Falah School of Engineering & Technology, an autonomous institute, Faridabad, Haryana. His field of interest includes power system, renewable energy generation and applications, and flexible ac transmission system.



**Mohd. Ilyas** was born on 2nd May 1976. He is an assistant professor of electrical & electronics with Al-Falah School of Engineering & Technology, an autonomous institute, Faridabad, Haryana. He received his B. Tech in electrical engineering & M. Tech in electrical power system & management from Jamia Millia Islamia, New Delhi. Now he is pursuing PhD from MD University, Rohtak. He has more than 12 years experience in teaching. He taught various subjects such as Power Electronics, Electrical measurement & measuring Instrument, Electric Power Generation etc. He has guided number of projects in teaching. He published six National and International papers. He attended workshops and National & International conferences.