

# Thermal Environmental Conditions and Indoor Air Quality in a Primary School Located Close to an Industrial Zone in Northern Peninsular Malaysia

Nurul Aqilah Alias<sup>1</sup>, Mardiana Idayu Ahmad<sup>2</sup>, Yusri Yusup<sup>3</sup>, Norli Ismail<sup>4</sup>

<sup>1,3,4</sup>Environmental Technology Division, School of Industrial Technology, Universiti Sains, Malaysia, 11800 Pulau Pinang, Malaysia

<sup>2</sup>Environmental Technology Division, School of Industrial Technology, Universiti Sains, Malaysia, 11800 Pulau Pinang, Malaysia  
Centre for Education and Training in Renewable Energy, Energy Efficiency and Green, Technology, Universiti Sains Malaysia, 11800 Pulau Pinang, Malaysia

**Abstract:** *This paper presents a work of field measurements on thermal environmental conditions and indoor air quality factors in a primary school located near an industrial zone in Northern Peninsular Malaysia. In this study, four rooms were chosen, and measurements were performed for eight hours from October 2014 to November 2014. The thermal environmental conditions and indoor air quality parameters were measured following class-II protocol of field measurements. This includes measurements of air temperature, globe thermometer temperature, average radiant temperature, relative humidity, air movement, particulate PM<sub>10</sub>, carbon dioxide and airborne bacteria. Results were analysed and compared with existing standards on thermal environmental conditions and indoor air quality: Malaysia Code of Practice on Indoor Air Quality 2010 DOSH Malaysia; ASHRAE Standard 55; Singapore Indoor Air Quality Standard and ISO Standard 7730.*

**Keywords:** thermal environmental conditions, indoor air quality, primary school

## 1. Introduction

Indoor environmental quality (IEQ) in buildings is very important because most people spent approximately 90% of their time indoors [1]-[2]. IEQ refers to the quality of a building's environment in relation to the health and wellbeing of occupants which is determined by many factors including thermal environmental conditions, indoor air quality (IAQ), lighting and acoustic comfort. Amongst these factors, thermal environmental conditions and IAQ are amongst the important factors as it directly impacts the occupants' comfort level and health, especially in tropical climate [3]. A good thermal environment is essential for an occupant which is related to thermal comfort. By definition, thermal comfort refers to "that condition of mind which expresses satisfaction with the thermal environment and is assessed by subjective evaluation", while thermal environment is defined as "the characteristics of the environment that affect a person's heat loss" [4]. From these two definitions, it can be seen that there is interconnectedness between thermal environmental conditions and occupants' thermal satisfactory which would affect their performance and productivity in an indoor environment. Besides, good IAQ is a necessity to human life in giving a guarantee to the comfort of living. Thermal environment, in terms of thermal comfort is a key factor that can affect occupants' comfort, health and performance [5] which there is a contact of the thermal interaction between the body and surrounding environment including school pupils [6]. In thermal comfort, generally, there are six factors that disassemble thermal interaction, such as humidity, air speed, surrounding temperature, air temperature, metabolic rate and clothing insulation [7]. The first four factors are the thermal environmental conditions while the other two represent the personal variables.

Good or poor IAQ is indicated by the level or concentrations of several indoor air pollutants or parameters in which poor IAQ would contribute to indoor air pollution problems and sick building syndrome (SBS) in indoor environment. Indoor air pollution has been classified by World Bank as one of the most critical global environmental problem in developing countries. Human exposure to indoor pollution is highly probable to cause adverse health impacts as indoor air pollutant concentration is typically higher than outdoor air pollutant concentration [8]. In buildings, indoor air pollutants comprise of several parameters in terms of biological, physical, chemical contaminants and adequacy of ventilation. IAQ is much related to occupants' thermal comfort. Carbon dioxide (CO<sub>2</sub>) is one of the IAQ factors, acts as a ventilation indicator that helps to ensure ventilation systems delivers the recommended minimum quantities of outside air to building occupants. The indoor CO<sub>2</sub> concentration acts as a replacement of the ventilation levels per occupant as well as for the indoor bio effluents concentration such as body odours [9]. Another research also has proven that low ventilation rates (high concentration of carbon dioxide) can affect people in reducing their performance [10]. Besides, frequent exposure to indoor pollution may pose long and short term health effects to pupils and staffs, decrease levels of performance, disrupt the learning environment and pupils comfort [11]-[13]. Therefore, it is important to have an adequate carbon dioxide concentration and enough quantity of fresh air by occupants. In addition, good ventilation system and maintenance will contribute to thermal comfort by controlling temperature and humidity and spread an adequate amount of air to occupants thus help in removing pollutants [14]. Therefore, optimal indoor environment is necessary for building occupants [3]. This study aimed to determine the concentration of indoor air pollutants at selected primary school close to an

industrial area, and assess the measured levels by comparing with existing standards.

## 2. Methodology

### 2.1 Site Description

This study was carried out from October 2014 to November 2014 in a primary school located close to an industrial area in Northern Peninsular Malaysia. Four rooms were selected: classroom (CR), office (O), laboratory (L) and canteen (C). In order to obtain comprehensive information about the study area, preliminary data was collected in relation to physical characteristics of each room (Table 1).

**Table 1:** Physical characteristics of each room

	O	C	L	CR
Floor area (m <sup>2</sup> )	38	154	87	64
Level of the room	1	Ground floor	1	2
Mode of ventilation	Ceiling fan	Ceiling fan	Ceiling fan	Ceiling fan

### 2.2 Field Measurements

Measurements of thermal environmental conditions and IAQ parameters were carried out in each room following standard class-II protocol of field measurement. Air temperature ( $T_a$ ), globe thermometer temperature ( $T_g$ ), average radiant temperature ( $T_r$ ), relative humidity (RH), air movement, respirable particulate matter (PM<sub>10</sub>) and carbon dioxide (CO<sub>2</sub>) were monitored for eight-hour [15] while airborne bacteria samples were collected three times within the eight-hour period. Sampling equipment was placed at 1.2 m above floor level. A portable temperature and relative humidity system (Delta OHM, model 32.3 with accuracy of 1/3 DIN for temperature and  $\pm 2.5\%$  for relative humidity) was used to measure thermal environmental conditions: air temperature ( $T_a$ ), globe thermometer temperature ( $T_g$ ), average radiant temperature ( $T_r$ ), relative humidity (RH) and air movement. In order to measure CO<sub>2</sub> concentration, a carbon dioxide sensor/monitor (Telaire 7001 sensor: 0- 4000 ppm with  $\pm 50$  ppm measuring accuracy) connected to temperature and relative humidity with built-in data logger (Onset, 10573988) was used. PM<sub>10</sub> samples were collected on a glass microfiber filter (47 mm, Whatman), using a portable air sampler (MiniVol Airmetrics). The mass concentrations of particulate matter were then determined by gravimetric analysis based on the NIOSH Method 0600. The filter papers were weighed using an analytical balance (OHAUS, with accuracy of 10  $\mu\text{g}$ ). Passive air sampling method was applied to collect airborne bacteria samples. In this method, petri dishes containing agar nutrient media (Tryptic Soy agar media) were exposed at each sampling point for five minutes and then agar plates were incubated at 32°C for 48 hours. Prior to measurements of PM<sub>10</sub> and

airborne bacteria, field blank samples were prepared for quality assurance of the collected data and all equipment were calibrated in accordance with the manufacturer's recommendations.


## 3. Results and Discussion

The assessment of thermal environmental conditions is summarised in Table 1. Average globe thermometer temperature ranged from 28.2 °C to 29.9 °C in office, from 28.0 °C to 29.7 °C in canteen, from 28.0 °C to 29.5 °C in laboratory, and from 28.4 °C to 29.8 °C in classroom. Average radiant temperature ranged from 27.6 °C to 29.6 °C in office, from 27.8 °C to 29.7 °C in canteen, from 28.7 °C to 29.8 °C in laboratory, and from 28.4 °C to 29.4 °C in classroom. From this assessment, it was found that the air temperature, relative humidity and air movement in all rooms were exceeded the recommended range of the ASHRAE Standard 55 [4]. Thus, to ensure a comfort level in the room which would impact the productivity and performance of primary school pupils [6], a standard that provides minimum requirements for acceptable thermal indoor environment should be complied. Too high relative humidity can affect the growth and spreading of airborne microbes especially without adequate ventilation systems [16].

**Table 2:** Summary of the assessment for thermal environmental conditions

Parameter	O	C	L	CR	ASHRAE Standard 55
Air temperature, (°C)	28.67	28.86	28.9	29.25	22.5 - 26.0
RH, %	75.55	76.26	70.5	73.17	30 - 60
Air movement, ms <sup>-1</sup>	0.41	0.34	1.11	0.56	<0.25


The levels of PM<sub>10</sub> measured in each room are shown in Figure 1. It was found that the measured particle levels were different in each room. The PM<sub>10</sub> levels in this study were in a range of 24 to 203  $\mu\text{g}/\text{m}^3$ . The recommended threshold level for respirable particulates (for particulate  $\leq 10 \mu\text{m}$ ) in the Malaysian Code of Practice on Indoor Air Quality [17] is 150  $\mu\text{g}/\text{m}^3$ . While recommended acceptable average level for respirable airborne particles in Singapore Indoor Air Quality Standard [18] is less or equal than 50  $\mu\text{g}/\text{m}^3$ . High level of PM<sub>10</sub> was recorded in the laboratory compared to other rooms. This was most probably due to infrequent housekeeping activity in which coincides with a study done in [14]. It was found in the study that infrequent housekeeping activities were one of the causes of a high concentration of indoor PM<sub>10</sub>. However, further investigation needs to be carried out in the future to thoroughly study the impact of housekeeping activities on PM<sub>10</sub>.

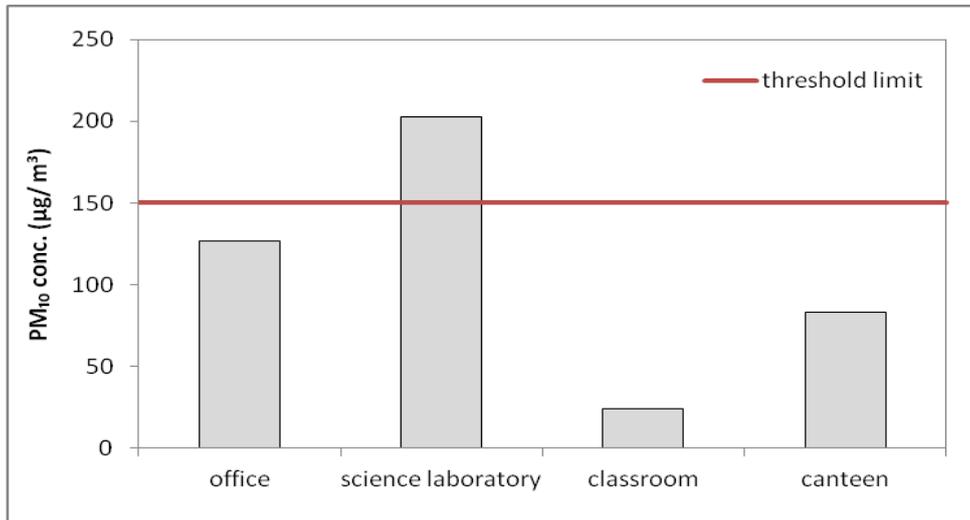

**Figure 1:** PM<sub>10</sub> concentration in each room

It was recorded the average CO<sub>2</sub> levels in all rooms were below 1000 ppm which complied with the recommended value for CO<sub>2</sub> exposure for 8-hour period prescribed by Malaysian Code of Practice on Indoor Air Quality [17] and ASHRAE Standards 62 [19]. The CO<sub>2</sub> level ranged from 361 ppm to 658 ppm (Figure 2). There was a slightly difference in CO<sub>2</sub> level between rooms especially during school hours.

This was due to the difference in numbers of occupants in each room. The concentration of CO<sub>2</sub> is normally associated with human occupancy [20]-[21], closing of doors and windows activity [12], [22]. High level of CO<sub>2</sub> also used to indicate an inadequate ventilation in the building [22].

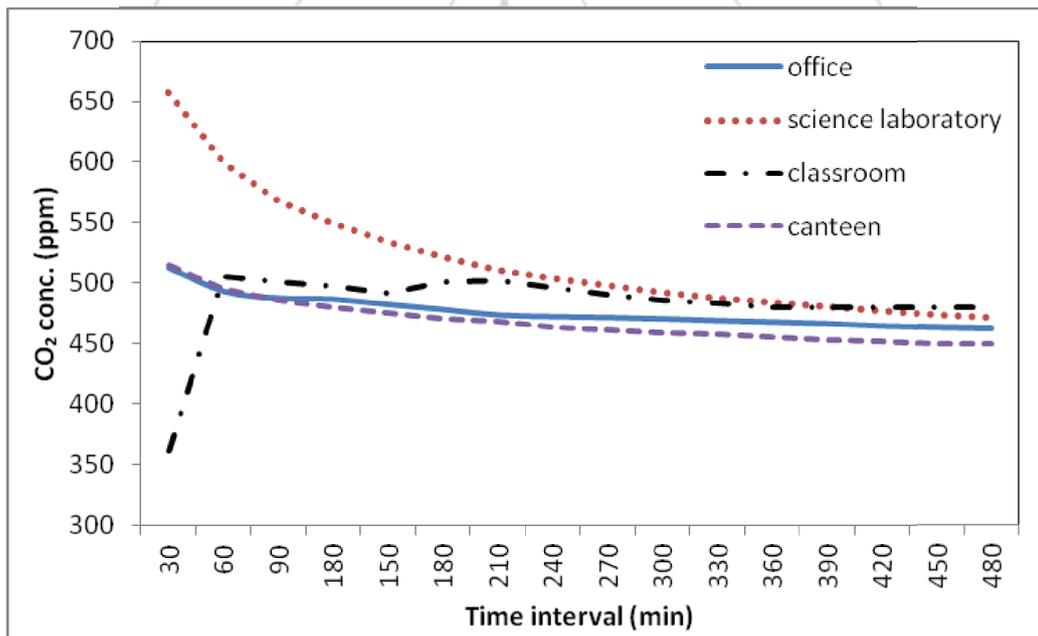

**Figure 2:** CO<sub>2</sub> concentration in each room

Table 3 shows the total bacteria count in each room sampled three times within the eight-hour period. It was observed that the average total bacteria count in all rooms were below the recommended acceptable limit of 500 CFU/m<sup>3</sup> in the Malaysian Code of Practice on Indoor Air Quality [17] and Singapore Indoor Air Quality Standard [18].

Table 3: Total bacteria count in each room

	O	C	L	CR
8 a.m.	38 CFU/m <sup>3</sup>	96 CFU/m <sup>3</sup>	19 CFU/m <sup>3</sup>	19 CFU/m <sup>3</sup>
10 a.m.	115 CFU/m <sup>3</sup>	77 CFU/m <sup>3</sup>	77 CFU/m <sup>3</sup>	134 CFU/m <sup>3</sup>
12 a.m.	38 CFU/m <sup>3</sup>	115 CFU/m <sup>3</sup>	115 CFU/m <sup>3</sup>	96 CFU/m <sup>3</sup>

#### 4. Conclusion

The averages of thermal environmental conditions in terms of air temperature, relative humidity, and air movement in all selected rooms were above the recommended acceptable level prescribed in ASHRAE Standard 55. PM<sub>10</sub> was found to be significant higher in laboratory which exceeded the recommended threshold level for respirable particulates (for particulate ≤ 10 µm) in the Malaysian Code of Practice on Indoor Air Quality. Control measures need to be taken in the future to ensure a comfort level in the rooms is achieved as the thermal environmental conditions would affect performance and progress of school pupils. In addition,

further investigations need to be carried out in the future i) to assess the thermal comfort in the primary schools by considering both objective (thermal environmental conditions) and subjective measurements (personal factors); ii) to analyse the relationship between thermal environmental conditions and IAQ parameters.

## 5. Acknowledgement

This study was technically support by USM RUI Grant (1001/PTEKIND/811229), CETREE Malaysia and Jabatan Pelajaran Negeri Pulau Pinang.

## References

- [1] A. Bonnacorsi, "On the Relationship between Firm Size and Export Intensity," *Journal of International Business Studies*, XXIII (4), pp. 605-635, 1992. (journal style)
- [2] R. Caves, *Multinational Enterprise and Economic Analysis*, Cambridge University Press, Cambridge, 1982. (book style)
- [3] M. Clerc, "The Swarm and the Queen: Towards a Deterministic and Adaptive Particle Swarm Optimization," In *Proceedings of the IEEE Congress on Evolutionary Computation (CEC)*, pp. 1951-1957, 1999. (conference style)
- [4] H.H. Crockell, "Specialization and International Competitiveness," in *Managing the Multinational Subsidiary*, H. Etemad and L. S. Sulude (eds.), Croom-Helm, London, 1986. (book chapter style)
- [5] K. Deb, S. Agrawal, A. Pratab, T. Meyarivan, "A Fast Elitist Non-dominated Sorting Genetic Algorithms for Multiobjective Optimization: NSGA II," KanGAL report 200001, Indian Institute of Technology, Kanpur, India, 2000. (technical report style)
- [6] J. Geralds, "Sega Ends Production of Dreamcast," vnunet.com, para. 2, Jan. 31, 2001. [Online]. Available: <http://nl1.vnunet.com/news/1116995>. [Accessed: Sept. 12, 2004]. (General Internet site)
- [7] Klepeis, Neil E., et al., "The National Human Activity Pattern Survey (NHAPS): a resource for assessing exposure to environmental pollutants." *Journal of exposure analysis and environmental epidemiology* 11.3, pp. 231-252, 2001.
- [8] Kembel, Steven W., et al., "Architectural design influences the diversity and structure of the built environment microbiome." *The ISME journal* 6.8, pp. 1469-1479, 2012.
- [9] L.Z. Zhang, J.L. Niu, Indoor humidity behaviors associated with decoupled cooling in hot and humid climates, *Building and Environment* 38, pp. 99– 107, 2003.
- [10] ASHRAE, A. N. S. I. "Standard 55-2004, Thermal environmental conditions for human occupancy." *American Society of Heating, Refrigerating and Air-Conditioning Engineering, Atlanta, GA*, 2004.
- [11] Mendes, Ana, et al., "Indoor air quality and thermal comfort in elderly care centers." *Urban Climate* 14, pp. 486-501, 2015.
- [12] Teli, Despoina, Mark F. Jentsch, and Patrick AB James., "Naturally ventilated classrooms: An assessment of existing comfort models for predicting the thermal sensation and preference of primary school children." *Energy and Buildings* 53, pp. 166-182, 2012.
- [13] Bessoudo, M., et al., "Indoor thermal environmental conditions near glazed facades with shading devices– Part I: Experiments and building thermal model." *Building and Environment* 45.11, pp. 2506-2516, 2010.
- [14] Jones, Andy P., "Indoor air quality and health." *Atmospheric environment* 33.28, pp. 4535-4564, 1999.
- [15] Santamouris, M., et al., "Experimental investigation of the air flow and indoor carbon dioxide concentration in classrooms with intermittent natural ventilation." *Energy and Buildings* 40.10, pp. 1833-1843, 2010.
- [16] Smedje, Greta, Dan Norback, and Christer Edling., "Mental performance by secondary school pupils in relation to the quality of indoor air." *Proceedings from Indoor Air '96, Nagoya, Japan*. 1, 1996.
- [17] Shendell, Derek G., et al., "Associations between classroom CO2 concentrations and student attendance in Washington and Idaho." *Indoor air* 14.5, pp. 333-341, 2004.
- [18] Lee, S. C., and M. Chang, "Indoor and outdoor air quality investigation at schools in Hong Kong." *Chemosphere* 41.1, pp. 109-113, 2000.
- [19] Mendell, Mark J., and Garvin A. Heath, "Do indoor pollutants and thermal conditions in schools influence student performance? A critical review of the literature." *Indoor air* 15.1, pp. 27-52, 2005.
- [20] Lee, Shun Cheng, Wai-Ming Li, and Chio-Hang Ao, "Investigation of indoor air quality at residential homes in Hong Kong—case study." *Atmospheric Environment* 36.2, pp. 225-237, 2002.
- [21] Wong, L. T., and K. W. Mui, "Evaluation on four sampling schemes for assessing indoor air quality." *Building and Environment* 42.3, pp. 1119-1125, 2007.
- [22] Zhai, Yongchao, et al., "Human comfort and perceived air quality in warm and humid environments with ceiling fans." *Building and Environment* 90, pp. 178-185, 2015.
- [23] DOSH, "Malaysia Industry Code of Practice on Indoor Air Quality." *Department of Occupational, Safety and Health, Ministry of Human Resources*, 2010.
- [24] SS 554, "Code of practice for indoor air quality for air-conditioned buildings." *Singapore Standard, SPRING, Singapore*, 2009.
- [25] ASHRAE, A. N. S. I., and A. S. H. R. A. E. Standard. "62.1. 2007, Ventilation for Acceptable Indoor Air Quality." *American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc., Atlanta, GA*, 2007.
- [26] Pegas, P. N., et al., "Indoor and outdoor characterisation of organic and inorganic compounds in city centre and suburban elementary schools of Aveiro, Portugal." *Atmospheric Environment* 55, pp. 80-89, 2012.
- [27] Madureira, Joana, et al., "Source apportionment of CO 2, PM 10 and VOCs levels and health risk assessment in naturally ventilated primary schools in Porto,

Portugal." *Building and Environment* 96, pp. 198-205, 2016.

[28] Yang, Wonho, et al., "Indoor air quality investigation according to age of the school buildings in Korea." *Journal of Environmental Management* 90.1, pp. 348-354, 2009.