

Simulation and Performance Analysis of 100 KW_p Grid Connected Rooftop Solar Photovoltaic Plant Using PVSYS

Pratish Rawat¹, Yashika Rawat²

¹ HOD and Assistant Professor, Mechanical Department, Poornima University, Jaipur, Rajasthan, India

² Scholar, Business Management Department, Dr. Hari Singh Gour Vishwavidyalaya, Sagar, Madhya Pradesh, India

Abstract: *The increasing energy demand in developing nations has triggered the requirement of energy security. This has made essential to utilize the potential of renewable energy resources. One of the best alternatives in renewable energy at large scale is grid connected solar photovoltaic systems. Performance evaluation of these grid connected solar PV plant is one of the most important aspect to assess the real-time behavior. Performance analysis could help in designing, operating and maintenance of new grid connected solar photovoltaic (PV) systems. In this study performance evaluation of 100 KW_p rooftop solar photovoltaic grid connected power plant commissioned at Poornima University, Jaipur is carried out. In this paper, the solar photovoltaic plant design aspects and its annual performance is elaborated. The various power losses such as losses due to temperature, losses due to internal network, power electronics losses, grid connected losses etc. and performance ratio are also calculated. The performance results of the 100 KW_p rooftop solar photovoltaic plant are also compared with the simulation values obtained from PVSyst V 6.39 software. The average final yield (Y_F) of the solar PV plant ranged from 1.60 to 5.60 h/d, and average performance ratio (PR) of 77.79% and capacity utilization factor (CUF) of 18.10% for September 2017 power generation are obtained.*

Keywords: Solar Energy, Solar PV Plant, Simulation, PVSyst V6.39, Solar Rooftop, Photovoltaics, Energy Efficiency.

1. Introduction

The 100 KW_p roof top solar photovoltaic (PV) system installed at the Poornima University, Jaipur serves as model for the installation of rooftop solar PV systems in institutional sector in India, which could play a major role in energy self-sufficiency and security while solving the nation's greenhouse gas emission problem. The main purposes of 100 KW_p rooftop solar photovoltaic (PV) plant were:

- 1) To provide electricity to the University through renewable source
- 2) To support research and development by providing system performance data.

The solar photovoltaic systems are one of the most promising and cost-effective substitute for diesel generators in developing countries like India. In India most of the people lives in rural and remote areas where either the grid is not available or electricity is not available all the time. The authorities in Spain are supporting a rural electrification project of 65 sites with 50 kW_p Solar PV systems [1]. A 1 kW_p SPV system was implemented in Jordon to supply power to houses for 24 hours [2]. For climatic conditions of Dhaka Bhuiyan and Asgar had designed a Solar PV system for 4 hours of operation per day for a residential area [3].

In electricity generation, India is presently the sixth-largest country and accounts for approximately 4% of the world's total annual electricity generation. India is ranked sixth in annual electricity consumption. Fossil fuel based electricity generation systems are responsible global warming and therefore affecting the environment. Therefore, it is necessary to generate electricity by some renewable sources which are environment friendly in nature. According to data

released by the Ministry of New and Renewable Energy (MNRE), total solar energy installations in India have reached 4.1GW [4]. A total of 358MW of grid-connected solar energy capacity has been installed in the first four months of this financial year 2015/16, with a target to deploy 1.4GW by the end of the fiscal year. In the off-grid solar PV installations, a total of 234MW has been installed [4]. Solar power technology remains the fourth-largest in terms of installed capacity among all renewable energy technologies in India.

2. Specification of plant

The rooftop solar photovoltaic (PV) plant at Poornima University, Jaipur is of 100 kW_p capacity. From the site of MNRE, India it was found that Rajasthan has average solar irradiation of 1266.52 W/m² and average sunshine hours is 5.5 hours. The plant will produce approximately 450 kWh per day and approximately 1,50,000 kWh per annum [5]. The per unit cost of electricity generated by 100 kW_p grid connected rooftop solar photovoltaic system is Rs. 3.37/kWh. The total CO₂ emission mitigation from the 100 kW_p grid connected rooftop solar photovoltaic system considering life of plant to be 30 years is found to be 7065000 Kg or 7787.82 ton. The carbon credit potential of 100 kW_p grid connected rooftop solar photovoltaic system installed at Poornima University is found to be Rs. 13286020.92 [5].

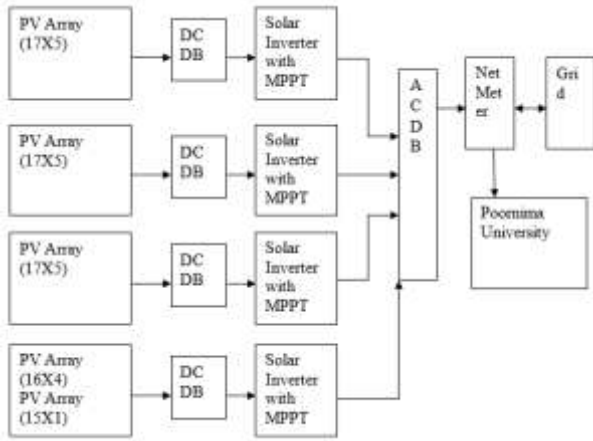


Figure 1: Block Diagram of 100 kW_p rooftop solar power plant at Poornima University



Figure 2: 100 kW_p rooftop solar power plant at Poornima University

Table 1: Specification of 100 kW_p rooftop solar power plant at Poornima University

Solar PV Module	
Model	ELDORA 300
Make	300 W
Open Circuit Voltage	45.1 V
Short Circuit Current	8.74 A
Maximum Current	8.05 A
Maximum Voltage	37.28 V
Efficiency	15.63 %
Fill Factor	76.13%
NOCT	45 °C
Number of Module	334
Solar Inverter	
Model	STP 25000TL-30
Number of Inverter	04
V (DC, maximum)	1000V
I (DC, maximum)	33A
V (DC, max. power point)	390-800 V
I (SC, PV)	43 A
Power	25 kVA
I (AC, maximum)	36.2 A

3. Performance Parameters

Array yield

Array yield is equal to the time for which the solar photovoltaic plant has to operate with nominal solar power P_0 to generate array energy E_A (Direct Current). Its units are kWh/d*kW_p.

$$Y_A = E_A/P_0$$

where, Array energy output per day $E_A = I_{dc} * V_{dc} * t$ (kWh),

I_{dc} = DC current (A)

V_{dc} = DC voltage (V)

P_0 = Nominal Power at STC.

Final Yield (Y_F)

It is the ratio of net energy output of the solar photovoltaic system to the rated power of the installed solar photovoltaic system [6-7]. Final yield provides the number of hours required by the solar photovoltaic system to operate at rated power to the yield the net energy. It is the normalized value of system energy output with respect to system size. Final yield estimates the solar photovoltaic system performance in terms of solar radiation resource.

$$Y_F = \frac{\text{System Energy Output}}{\text{System Rated Power(dc)}}$$

Reference Yield (Y_R)

It is the ratio of total in-plane solar insolation to the reference irradiance of solar photovoltaic system [6-7]. Reference radiation is considered as 1000W/m² at STC. Reference yield normalizes the available solar radiation with reference radiation. It measures the solar energy input for required output. It generally depends on site geographical condition, weather conditions and orientation of solar photovoltaic array. Reference Yield for the solar photovoltaic plant is the actual energy plant would have been generated under STC 1000W/m², 250C, 1.5 Air mass and no wind.

$$Y_R = \frac{\text{Total In-Plane Solar Insolation}}{\text{Reference Irradiance}}$$

Performance Ratio (PR)

Performance ratio is a dimensionless quantity and is defined as the ratio of final yield to the reference yield [6-7]. Performance Ratio gives details about the day impact of overall system losses on the rated output. The losses include solar photovoltaic array losses, tilt angle losses, loss due to dust, loss due to shade, loss due to variation in module temperature. Performance ratio has effect on system down time and failure of components. It is used to analyze the performance of solar photovoltaic system annually and decrease in performance ratio is an indicator of the degradation of the system performance. Performance ratio will indicate how close the solar photovoltaic plant is able to approach the ideal performance in real time conditions. Mathematically it is expressed as,

$$PR = \frac{\text{Final Yield}(Y_F)}{\text{Reference Yield}(Y_R)}$$

Capacity Utilization Factor (CUF)

Capacity Utilization Factor (CUF) is defined as the ratio of actual energy output of the solar photovoltaic system to the energy output system would generate if it works at rated power for 24 Hrs/day/month/year. It is a dimensionless quantity and used to evaluate the performance of solar PV units [14].

$CUF = \text{Energy measured (kWh)} / (365 * 24 * \text{installed capacity of the plant})$.

To evaluate the various losses involved in solar photovoltaic system it is necessary to calculate array yield, capture losses and system losses. Capture losses includes thermal loss

which depends on solar module temperature and other losses which depends on losses due to dust accumulation, variable irradiation etc. System losses include DC and AC cabling losses.

Inverter efficiency

The ratio of AC power generated by the inverter to the DC power generated by the PV array system is called inverter efficiency. The instantaneous inverter efficiency is given by, $\eta_{inv} = P_{AC} / P_{DC}$.

System efficiency

The instantaneous daily system efficiency is given as solar photovoltaic module efficiency multiplied by inverter efficiency.

$$\eta_{sys,T} = \eta_{PV,T} * \eta_{inv,T}$$

Energy output or energy fed to utility grid

The energy generated by the solar photovoltaic system is the measure of energy across the inverter output terminals for every minute. It is defined as the total daily monitored value of AC power output and the monthly AC energy generated.

Array Yield (Y_A)

Array yield of the system is the ratio of annual/monthly/daily energy output to the installed capacity of PV system.

$$Y_A = \frac{E_A(KWhAC)}{P_r(KwDC)}$$

Capture Loss (L_c)

The difference between reference yield and array yield is called Capture losses.

$$L_c = Y_R - Y_A$$

System Loss (L_s)

The difference between array field and final yield is called System losses.

$$L_s = Y_A - Y_f$$

The performance of 100 KWp rooftop solar PV plant was carried out and the performance ratio (PR) was found to be in the range of 0.46 to 0.78 and the variation is shown in figure 3. The reference yield was found in the range of 4.5 to 6.9 h/d and the final yield was found in the range of 1.6 to 5.6 h/d for power generation by solar photovoltaic plant in September 2017 and shown in figure 4. The capacity utilization factor (CUF) of 100 KWp rooftop solar PV plant was found in the range of 0.08 to 0.25 and the variation is shown in figure 5. The results so obtained from experimental data are compared with simulated data using PVsyst software.

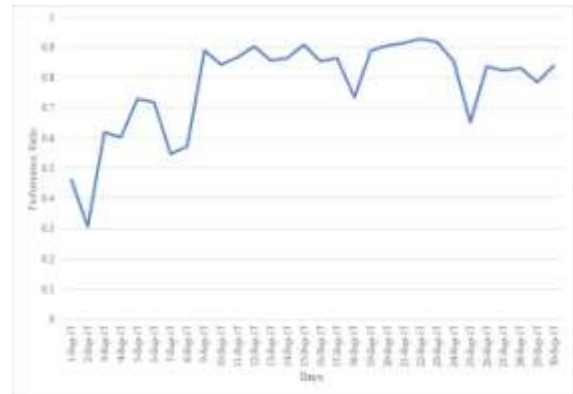


Figure 3: Variation of Performance Ratio for September 2017



Figure 4: Variation of reference yield (Y_R) and final yield (Y_F) for September 2017

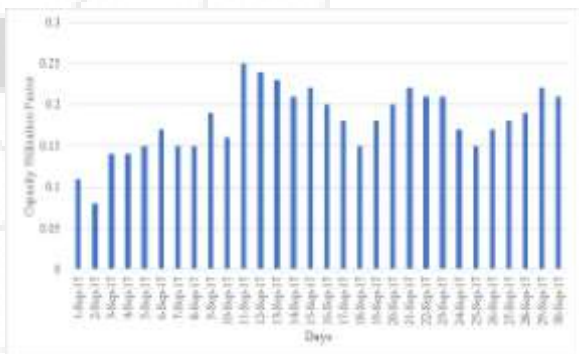


Figure 5: Variation of capacity utilization factor (CUF) for September 2017

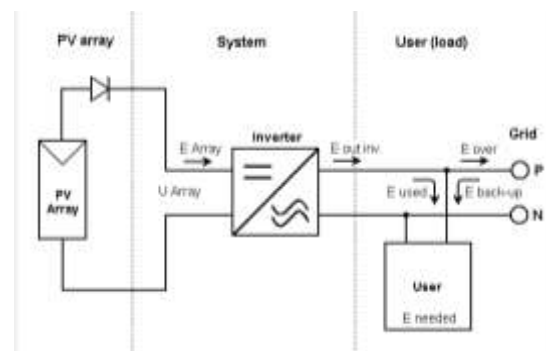


Figure 6: Block diagram of system

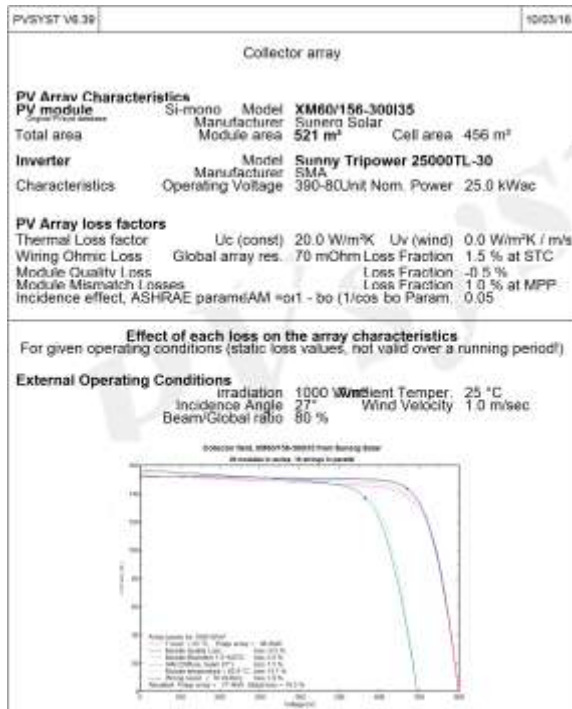


Figure 7: Simulation of 100KWp rooftop solar power plant using PVsyst

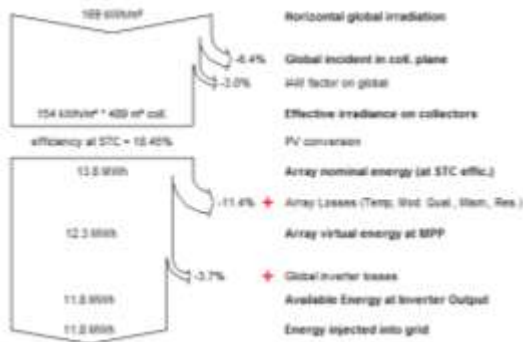


Figure 8: Sankey Diagram of estimated Losses of 50KWp PV plant

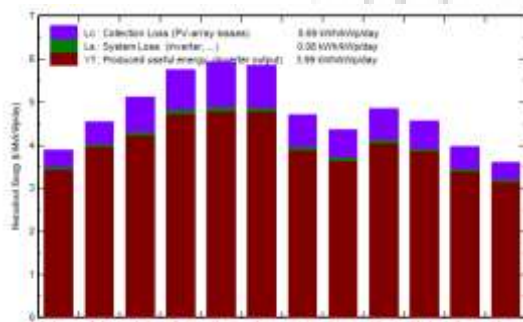


Figure 9: Normalized production per month

Balances and main results								
	GlobHor	T Amb	GlobInc	GlobEff	EArray	E_Grid	EffArrR	EffSysR
	kWh/m ²	°C	kWh/m ²	kWh/m ²	kWh	kWh	%	%
January	124.0	15.10	120.3	115.1	9773	9580	16.63	16.30
February	131.9	18.00	127.5	122.9	10190	9988	16.35	16.03
March	169.3	24.40	158.4	153.6	12065	11822	15.59	15.27
April	183.3	29.10	172.7	168.0	13050	12786	15.47	15.15
May	197.8	31.50	184.4	179.2	13655	13378	15.16	14.85
June	187.2	30.80	175.6	170.8	13186	12920	15.37	15.06
July	158.1	28.40	145.8	141.5	11091	10867	15.57	15.26
August	146.0	27.40	135.0	130.8	10373	10164	15.73	15.41
September	153.6	27.30	145.5	141.3	11190	10966	15.74	15.43
October	148.5	25.70	141.6	137.1	10989	10773	15.88	15.57
November	124.8	21.30	119.2	114.3	9363	9176	16.08	15.76
December	115.9	16.80	111.6	106.3	8949	8771	16.41	16.08
Year	1840.4	24.68	1737.6	1680.8	133871	131190	15.77	15.45

Figure 10: 100KWp rooftop solar power plant output

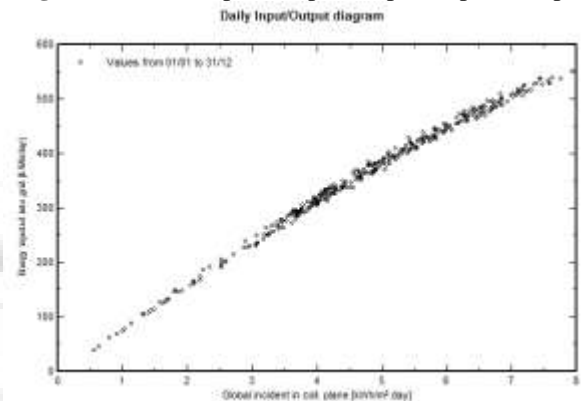


Figure 11: Daily input and output diagram

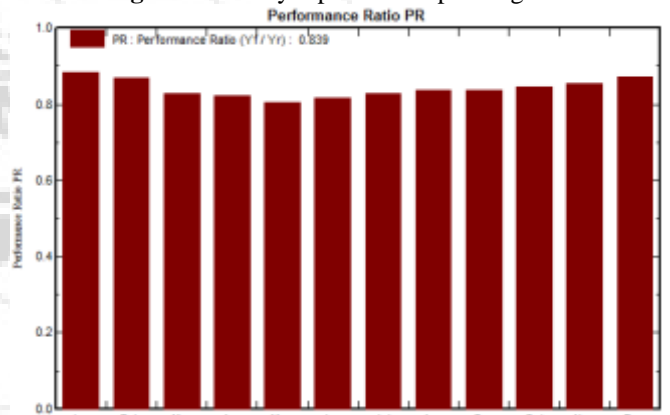


Figure 12: Performance ratio (PR) per month

4. Conclusion

Performance analysis of 100 KWp rooftop grid connected PV system installed at Poornima University, Jaipur had been investigated. Following observations were drawn:

- 1) Average daily energy output in September 2017 is 423.342 KWh.
- 2) Average daily performance ratio (PR) in September 2017 is 77.79%.
- 3) The average capacity utilization factor (CUF) in September 2017 is 18.10%.

The performance evaluation study throws light on different aspects related to plant operation and further expansion. Comparison of performance parameters like performance ratio (PR) and capacity utilization factor (CUF) for solar photovoltaic plants at different locations is summarized in table 2. If the performance ratio is maintained above 0.85, it results in optimal design without shading effect. Capacity

utilization factor is an important measure to assess the output energy of solar photovoltaic system. It has impact on economics of the system.

Table 2: Comparison of performance parameters like performance ratio (PR) and capacity utilization factor (CUF)

S. No.	Plant Location	Performance Ratio	CUF
1	Tennessee Plant TN, United states [8]	0.75-0.89	0.08-0.21
2	PV park, University of Cyprus [9]	0.74-0.85	
3	Faculty of Engineering, DEI, Agra, India [6]	0.47-0.91	0.06-0.13
4	Dublin, Ireland [10]	0.72-0.91	0.05-0.15
5	Tulin Village, Nepal [11]	0.29-0.40	
6	Solar Energy demonstration complex, Chosun University, Korea [12]	0.57-0.73	
7	Khatkar Kaln, India	0.74(average)	
8	Vishnu Solar Plant, India [13]	0.55-0.89	0.02-0.107
9	Ramagundam, India [14]	0.86 (average)	0.17 (average)
10	Poornima University, Jaipur, India	0.78 (average)	0.18 (average)

5. Acknowledgement

I am thankful to **Dr. K.K.S. Bhatia**, President, **Dr. Manoj Gupta**, Pro-President and **Dr. B.K. Sharma**, Dean, Poornima University, Jaipur for their cooperation and support to carry out this project. I am also thankful to all my colleagues in the Department of Mechanical Engineering for rendering necessary assistance and help during testing and investigations of this project.

References

[1] X. Vallve, J. Serrasolsest, Design and operation of 50 kWp PV rural electrification project for remote sites in Spain, *Solar Energy* 59 (1–3) (1997) 111–119.

[2] S. Habali, M. Taani, Renewable energy application in Jordan, in: The twentieth European PV conference at Barcelona, June 5–10, 2005.

[3] M.M.H. Bhuiyan, M.A. Asgar, Sizing of a stand-alone photovoltaic power systemat Dhaka, *Renewable Energy* 28 (2003) 929–938.

[4] <http://mnre.gov.in/mission-and-vision-2/achievements>

[5] Pratish Rawat and Ashwani Kapoor, “Life Cycle Assessment of 100 kWp Grid Connected Rooftop Solar Photovoltaic (SPV) System Installed at Poornima University, Jaipur”, *International Journal of Thermal Energy and Applications*, 2016, 2 (2), 19-26.

[6] The History of Solar, US Department of Energy Efficiency and Renewable Energy. https://www1.eere.energy.gov/solar/pdfs/solar_timeline.pdf

[7] K. Pritam satsangi, D, Bhagwan Das and A.K. Saxena, "Performance Evaluation of 147.5KWp Hybrid Solar PY Plant", National Systems Conference-2014, JNTUH College of Engineering, Hyderabad, 5-7 November 2014.

[8] Emmanuel Kymakis, Sofoklis Kalykakis, Thales M. Papazoglou, "Performance analysis of a grid connected

photovoltaic park on the island of Crete", *Energy Conversion and Management* 50 (2009) 433438.2008

[9] Trueblood, e.; Coley, S.; Key, T.; Rogers, L.; Ellis, A.; Hansen, e.; Philpot, E., "PY Measures Up for Fleet Duty: Data from a Tennessee Plant Are Used to Illustrate Metrics That Characterize Plant Performance," *Power and Energy Magazine, IEEE*, vol. II, no.2, pp.33,44, March-April 2013

[10] Makrides, George, et al. "Performance assessment of different photovoltaic systems under identical field conditions of high irradiation." *PY RES Conference*. 2007.

[11] Ayompe, L. M., et al. "Measured performance of a 1.72 kW rooftop grid connected photovoltaic system in Ireland." *Energy conversion and management* 52.2 (2011): 816-825.

[12] M Avishek, Zahnd A, Mckay, Ellul A, "The Importance of Monitoring and Performance. Analysis of a Rural Solar PY Electrification", (2009), September, ANZSES, 47 Annual conference, Townsville, Queensland, Australia.

[13] Zheng-Guo Piao, Byung-Ik Jung, Youn-Ok Choi, Geum-Bae Cho, "Performance Assessment of 3KW Grid Connected PY Systems in Korea", 31 International Telecommunications-Energy Conference- 2009 (INTELEC-2009), IEEE, Incheon, Page 1-5

[14] Omkar K, Srikanth, Swaroop KP and Rama Rao PVV, "Performance Evaluation of 50 KWp Rooftop Solar PV Plant", *International Conference on Industrial Instrumentation and Control (ICIC)*, 2015, 761-765.

[15] B. Shiva Kumar and K Sudhakar, "Performance evaluation of 10 MW grid connected solar photovoltaic power plant in India", *Energy Reports*, 2015, 184-192.

[16] Pratish Rawat, "Experimental Investigation of Effect of Environmental Variables on Performance of Solar Photovoltaic Module", *International Research Journal of Engineering and Technology*, 2017, Vol. 04 (12), 13-18.

[17] Pratish Rawat, "Performance Analysis of 300W Solar Photovoltaic Module under Varying Wavelength of Solar Radiation", *International Journal for Research in Applied Science and Engineering Technology (IJRASET)* Volume 5, Issue XI, Page No: 2478-2482.

[18] IEC Photovoltaic system performance monitoring guidelines for measurement, data exchange and analysis. IEC standard 61724. Geneva, Switzerland; 1998.

[19] Pratish Rawat, "Exergy Performance Analysis of 300 W Solar Photovoltaic Module", *International Journal of Engineering Sciences & Research Technology* Vol. 6 (3): March, 2017.

[20] Yashika Rawat and Pratish Rawat, "Smart Cities or Smart People? What India Actually Need: A Review", *International Journal of Science, Environment and Technology*, Vol. 6, No 6, 2017, 3578 – 3583.

Author Profile



Mr. Pratish Rawat is currently working as HOD and Assistant Professor in Department of Mechanical Engineering in Poornima University, Jaipur. He obtained his B.E. in Mechanical Engineering from R.G.P.V. Bhopal and MTech in Renewable Energy

from Maulana Azad National Institute of Technology (MANIT), Bhopal. He has also attended AICTE-QIP on Solar Energy Applications at IIT Delhi. His major research areas include: Energy Management and Audit, Climate Change, Hybrid System, Solar Thermal & PV Systems, Wind Energy and Energy Conservation. He has published number of research papers in national and international journals. He also published book on Solar PV/T with LAP Lambert Academic Publishing.



Ms. Yashika Rawat is a B.E. in Electronics and Communication from R.G.P.V. Bhopal and currently pursuing her Master of Business Administration (MBA) at Dr. H. S. Gour Vishwavidyalaya (Central University), Sagar. She has successfully conducted customer satisfaction survey for Patanjali Group FMCG products and Porter's five forces analysis for Honda Motorcycles and Scooters India Private Limited. She has also accomplished a project on financial analysis of performance of M.P. Apex bank Bhopal. She has special interest in renewable energy applications, technologies for smart cities, entrepreneurship and emerging paradigms for managing start-ups.

