

# “Protection of Induction Motor Using Programmable Logic Controller”

<sup>1</sup>Yogesh Godhwani, <sup>2</sup>Sachin Dev Barman, <sup>3</sup>Dr. Sushil Kumar

<sup>1</sup>Pragati College Of Engineering & Management,  
Old Dhamtari Road, Sejbahar, Raipur  
yogigodhwani@gmail.com

<sup>2</sup>Pragati College Of Engineering & Management,  
Old Dhamtari Road, Sejbahar, Raipur  
sachin.dev39@gmail.com

<sup>3</sup>Pragati College Of Engineering & Management,  
Old Dhamtari Road, Sejbahar, Raipur  
Sk1\_bit@rediffmail.com

**Abstract:** Three phase Induction Motors are the “functional basis” of all the industrial processes today and the single phase Induction Motors are the “frontline movers” for all commercial purposes. Therefore we can say that Induction Motors are universally employed motors but a remarkable aspect of these motors the various problems (faults) associated with its Microcontrollers based protection system, Programmable Integrated Circuit (PIC) based protection system and Programmable Logic Controller (PLC) based protection system. All such protection systems are widely used today due to their inherent several advantages. In this study, we will be focusing on the automated control and protection system of IM.

The most important aspect employed in the industrial processes involving Induction motors is their speed control. The speed control should be such that the motor will be adequately able to overcome the load inertia as well as the vibrations taking place during the heavy load operations. These vibrations are needed to be controlled by the speed control mechanism because such vibration may lead to uneconomical operation or even damage of the motor. In this paper speed control of an IM using the Variable Frequency Drive (VFD) using an automation technique (using PLC) is explained.

**Keywords:** Workhorses, PLC, PIC, Fault diagnosis, Computer controlled system, computerized monitoring, VFD

## 1. Introduction

Because of their wider applications in electromechanical energy conversion, mainly due to their low cost, reasonably small size, ruggedness, low maintenance, and operation with an easily available power supply, IM’s are the main workhorses of industrial prime movers and of commercial use. Although Induction machines are reliable, they are subjected to some undesirable stresses, causing them some faults resulting in failures. Researchers have studied a variety of machine faults and have come to a conclusion that machine failures include mechanical and insulation faults.

### (A) INSULATION SYSTEM FAILURE

Insulation system failure plays an important role in electrical machine failure. The major insulation failures are caused by moisture and overtemperature.

### (A) MECHANICAL FAILURE

The major faults in this category can be broadly classified as

- (1) Stator faults.
- (2) Broken rotor bars
- (3) Static and/or dynamic air gap irregularities
- (4) Misalignment
- (5) Bearing and gear box failures.

The possible detection methods to identify the motor faults are listed as follows

- (a) Vibration monitoring
- (b) Electromagnetic field monitoring using search coils
- (c) Chemical analysis
- (d) Temperature measurement
- (e) Speed measurement
- (f) Voltage measurement
- (g) Current measurement
- (h) Radio frequency emission monitoring
- (i) Acoustic noise measurement
- (j) Partial discharge method



**Figure 1 : Block Diagram**

The critical components of an IM that need to be monitored include the stator winding temperature, bearing temperature, value of voltage, current and speed. The monitoring methods and degree of protection can vary significantly. Normally, the rotor temperatures are not directly measured, but rather the stator or bearing temperatures provides an indirect measurement of the rotor performance. For the direct measurement of rotor

temperatures, a radio frequency telemetry system is required which is somewhat expensive, uncommon and in most cases unnecessary.

#### WAYS TO MONITOR AN IM

There are various methods to protect an IM and these methods have come into picture after having a deep research over it. Firstly, the protection of IM by means microcontroller was invented. After that the protection of IM by using PIC was came into picture. But both these methods of monitoring an IM has some defects which were eliminated in further research. The new method of monitoring an IM which has eliminated the defects of previous two methods is the protection of IM using PLC.

#### METHOD WHICH WE ARE USING

This paper explains a PLC based protection and monitoring of three phase IM. The basic structure of PLC is shown in fig.1. From fig.1, the PLC systems are equipped with special I/O units appropriate for direct usage in automation systems. The I/O components, such as voltage sensor, current sensor, temperature sensor etc, can directly be connected to the input. The driver components of the control circuit such as contactors and solenoid valves can directly be connected to output. The new solutions for various faults of the voltages, currents, speed and temperatures of an IM occurring in operation have been achieved with the help of a PLC.

A programmable logic controller (PLC) or programmable controller is a digital computer used for automation of electromechanical processes, such as control of machinery on factory assembly lines, control of amusement rides, or control of lighting fixtures. PLCs are used in many different industries and machines such as packaging and semiconductor machines. Unlike general purpose computers, the PLC is designed for multiple inputs and output arrangements, extended temperature ranges, immunity to electrical noise, and resistance to vibration and impact. Programs to control machine operation are typically stored in battery-backed or non-volatile memory. A PLC is a example of real time system since output results must be produced in response to input conditions within a bounded time, otherwise unintended operation will result. There are different types of PLCs according to the type of input/output ports, they are as follows:-

- (1)Fixed type and
- (2)Expandable PLC.

In Fixed type PLC the input/output ports cannot expand while in Expandable PLC the input/output ports can expand.

#### Various Manufacturer Of Plc And There Software


COMPANY NAME	MODEL NAME	SOFTWARE	SCADA
SIEMENS	S7-200,S7-300,S7-400	MicroWin Simatic Manager	Win CC

ABB	AC 500M, AC 800M	Control Builder	SCADA Portal
AB ALLEN BRADLEY	MicroLogix 1000/1200/1500	RS Logix 500, RS Logix 5000	RS Vtec
GE Fanuc	Versa Max 90-30, 90-70/PAC	Proficy M/C Edition	Cimplicity
Crouzet Millenium	CD-10, CD-20,CD-30	Millenium3	GE Fanuc

The PLC which we are using in this paper is Crouzet Millenium (CD 10) PLC. This programmable logic module provides a total of 10 I/O points (6 inputs and 4 outputs). It has two types of controllers

- (1)LCD type:- with display screen and keypad
- (2)LED type:- without display screen and without operating keypad.

#### External Appearance

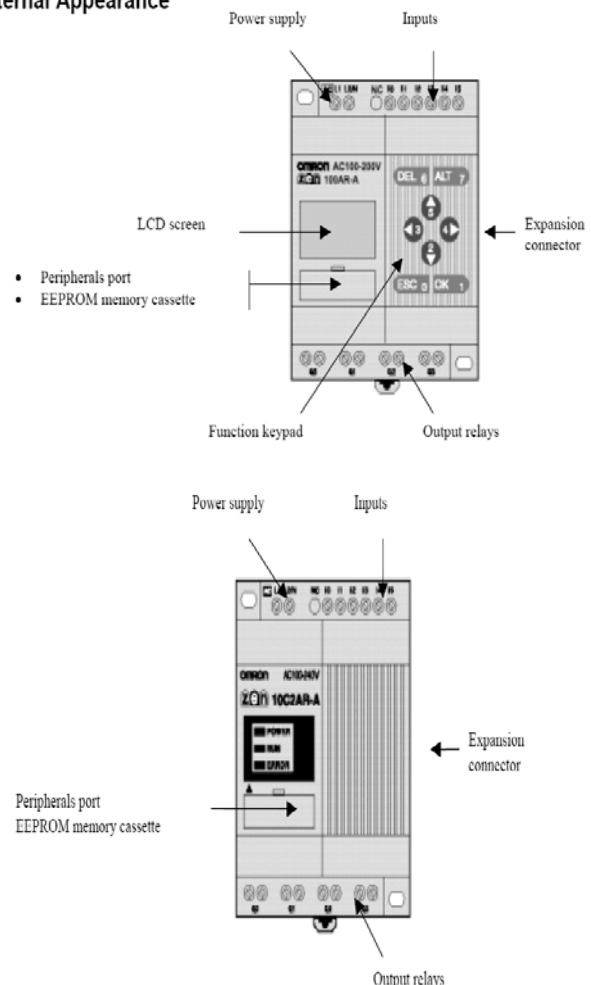



#### Main Features Of The Module

The following are some of the most important features:-

- (1)Capacity to carry out small scale automated control at a low cost, thus encouraging large scale production.
- (2)Ladder diagram programming directly is possible in the LCD type CPU.
- (3)Upgrades of upto 18 inputs and 16 outputs using 3 expansion modules is a recent advance.

- (4) Protection against power supply failures. For this battery is provided (optional).
- (5) Such PLCs are equipped with 8 configurable timers in 4 operating modes along with 3 timer ranges.
- (6) Direct AC input between 110 V to 240 VAC.


An analog module is primarily required for processing the analog signals, which arrive at the inputs as a response of the faults. Analog modules usually work according to 8 bit or 12 bit systems. One or multiple analog sensors can be connected to the analog module in accordance with their types.

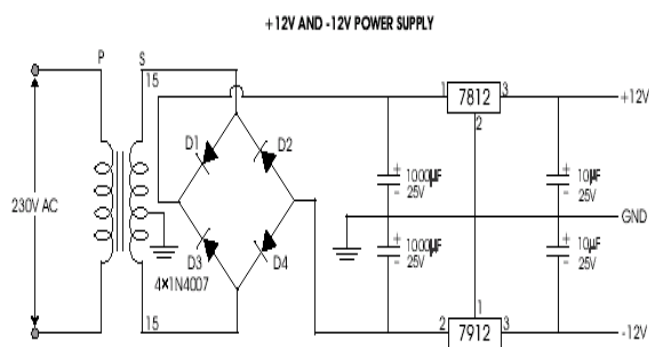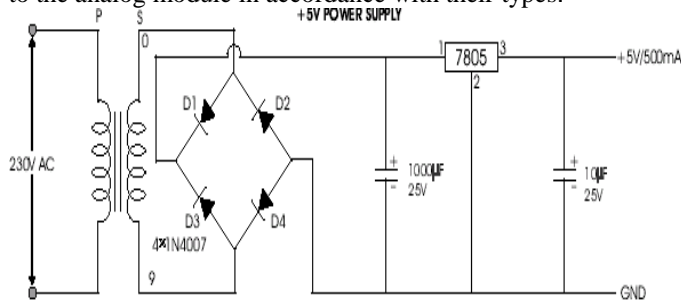

**Figure 3 :Circuit Diagrams(Power Supply)**

## 2. Control System Of IM

A block diagram for the protection of IM is shown in fig.2. It consists of the measuring instruments for the measurement of the voltage, the current, the winding temperature and the rotor speed. The proposed protection system can better be understood under the following three categories as the hardware, the instrumentation and the software. The tasks of these categories are explained in the following sections.

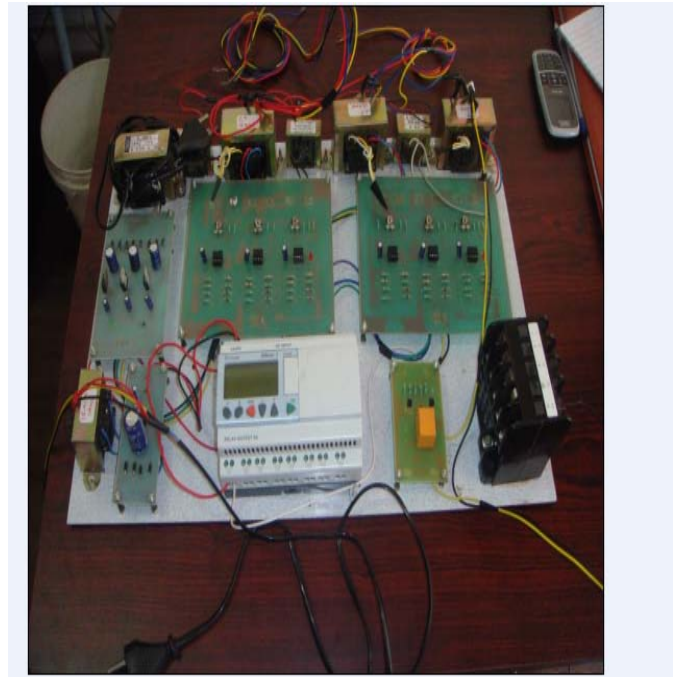


**Figure 4 :Hardware Developed**

The protection system used in this study consists of a .25kW/1500 r/min single-phase IM, three voltage transformers with transformation ratio of 220/5 V, three current transformers with current ratio of 1000:1, a temperature sensor with transformation ratio of 10 mV for each 1 °C increasing temperature, and an incremental encoder with 360 pulse per revolution used for measuring the rotor speed, a true rms to dc conversion card, a CPU 224, and Crouzet Millenium CD 10 series PLC. A photograph of the proposed system is demonstrated in Fig. 3.

### B. Instrumentation

The currents and the voltages of the motor in the protection system were measured using the measurement card available in the laboratory including three current transformers and three voltage transformers. This card includes an amplifier with opamps, a gain potentiometer, and a filter circuit used to change the current value. The outputs of the measurement card were applied to the input port of true rms-to-dc conversion card. The AD536A integrated circuit was used for the true rms-to-dc conversion. The AD536A is a complete monolithic integrated circuit that performs true rms-to-dc conversion. It offers a good performance that is comparable or superior to that of hybrid or modular units that cost more. The AD536A directly computes the true rms value of any complex input waveform containing ac and dc components. Potentiometers and filter circuit, shown were used on the true rms-to-dc conversion card for changing the current and the voltage values. Converted current and voltage values were then transferred to the PLC analog module through the true rms-to-dc conversion card. To measure the speed of the motor, an incremental encoder was connected to motor shaft. The incremental encoder with 360 pulses per revolution was used for measuring the rotor speed. The encoder output with pulsewidth modulation (PWM) is converted to dc voltage value using conversion circuit. The temperature of the motor was measured with an LM-35 sensor placed between the coils. The LM-35 sensor is a linear component that can produce 10 mV voltages per 1 °C. The temperature signal was magnified and transferred to PLC analog module. On the

nameplate of the motor, maximum ambient temperature was given as 40 °C. Over this value, the motor is stopped by the PLC.

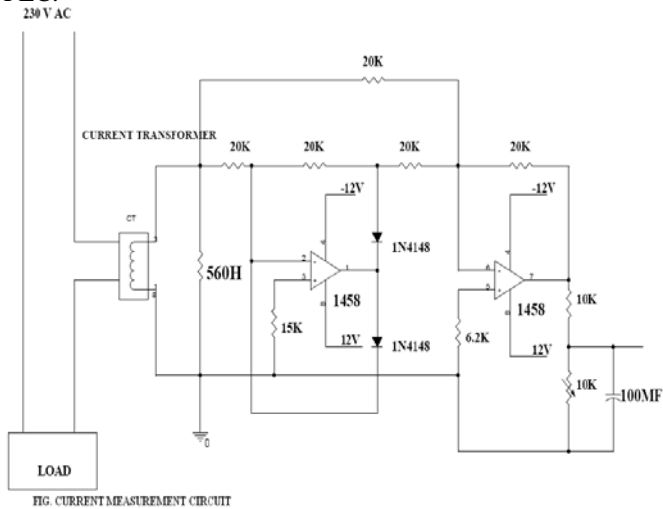

### C. Speed Control

To achieve the protection & speed control of the IM simultaneously and easily, a PLC program has been developed. The PLC, as a well known fact, responds to signal changes according to the program which is stored in its ROM and runs it to provide the necessary output. Also, the PLC system provides a design environment which helps the LADs to be developed, verified, tested, and diagnosed. First, the high-level program is written in LAD, which is then converted to binary instruction codes, so that they can be easily stored in RAM or erasable programmable read-only memory (EPROM) devices. Each instruction is then decoded and executed by the CPU successively. The function of the CPU is, therefore, to control the operation of memory and I/O components and to process data according to the program fed to the PLC. Each input and output connection point on a PLC has an address location of the memory used to identify the I/O bit.

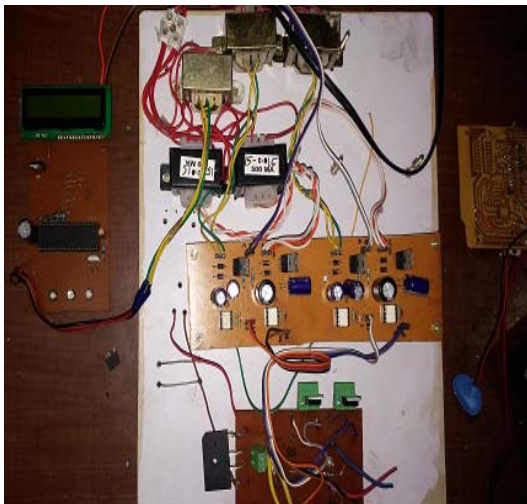


Figure 5 :Control Module

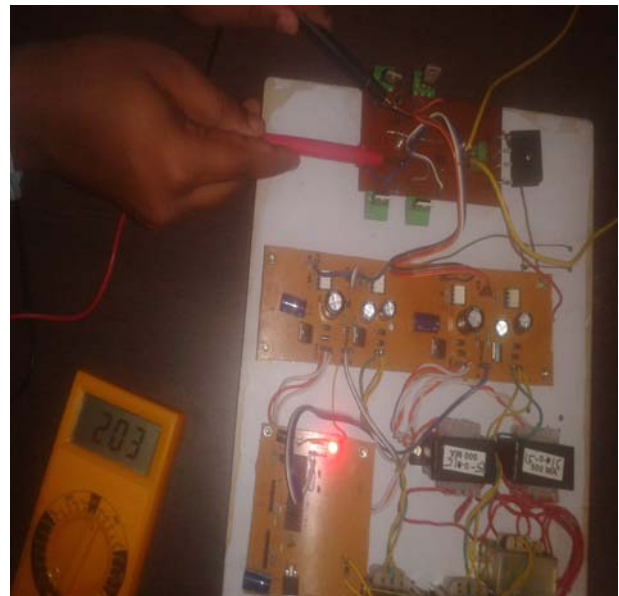


Figure 6 : Testing Of Control Module

### D. Developed Software

LOGIC DIAGRAM OF THE PROGRAM IS GIVEN IN FIG. BELOW

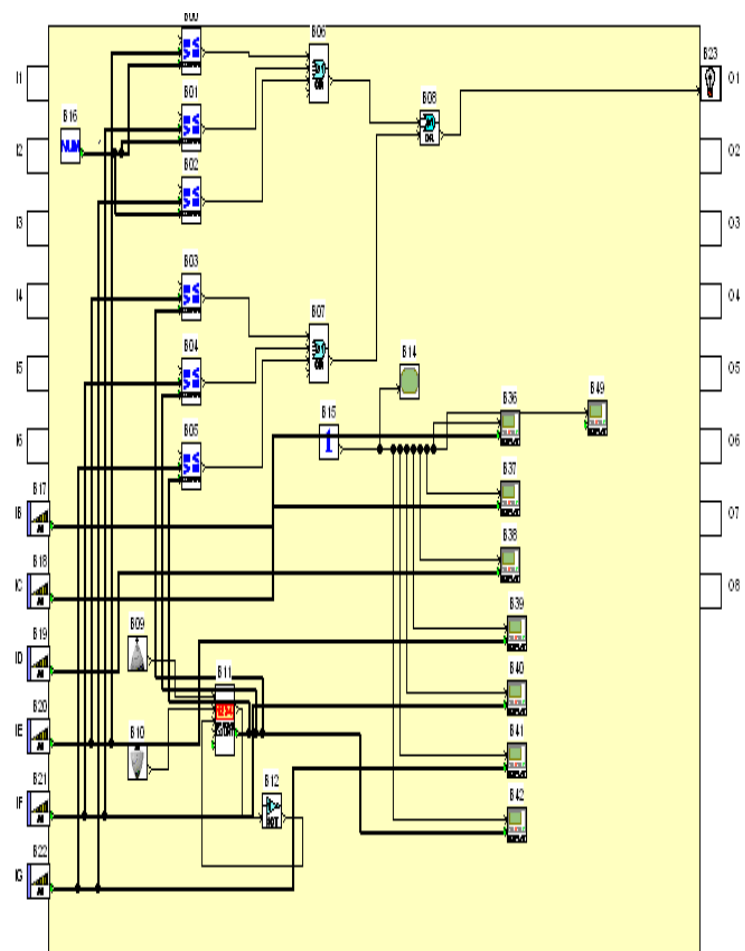


Table 1  
Motor Electrical Variables Achived On Computer

Variable	Symbol	Input	Unit
Phase voltage	V	Analog module	volt
Phase current	I	Analog module	Amp
Speed	n	Analog module	rpm
Temperature	T	Analog module	Degree

The computer interface program has been written using package PLC software known as Millenium 3. The communication is achieved between the PLC and computer and thus results are obtained. The motor electrical variables with description (symbol, unit and type of input) are given in table.1. The logic is then developed on computer screen with the help of PLC software. As we know that each and every PLC has it's own execution time. The execution time of the PLC which we are using is about 0.40 microseconds. Thus the PLC software developed is been scanned at each and every movement. According to the control procedure the data are first read and then calculated. The transient time of the motor is defined which is continuously been controlled by the program. If the defined time is less then the transient time, the program goes to control procedure and at the same time the PLC sends a signal to the control circuit of the motor due to which the motor stops.

The phase voltage, phase current, rotor speed and winding temperature are then directly being displayed on the computer screen with the help of the software developed. After having all these data they are controlled considering their tolerance values. The system continues to run under normal condition but in case any kind of fault occurs on the system i.e. if the value of phase voltage, phase current, rotor speed or winding temperature increases beyond it's defined value then the PLC will immediately gives signal to the control circuit of the motor and thus the motor stops.

### 3. Conclusion

A 0.25 kW single-phase IM has been connected to the protection system through the measuring components, as illustrated in Fig. 5. The proposed PLC-controlled protective relay deals with the most important types of these failures, which are summarized as the phase lost, the over/undercurrent, the over/undervoltage, the unbalance of supply voltages, the overload, the unbalance of phase currents, the ground fault, and the excessive repeated starting. If any fault is observed during online operation of the motor, a warning message appears on computer and then the motor is stopped. When an undefined fault occurs, the motor stops without giving any description. In this case, the fault can be described and found by the operator.

Speed control of an Induction Motor is also an important aspect. The test has been found successful in detecting the faults and in recovering them. Also speed of an Induction motor using VFD method through PLC is done successfully.

The results showed that a reliable PLC-based protection system & speed control including all

variables of the three-phase IMs and operators has been developed.

### References

- [1] M. Peltola, “Slip of ac induction motors and how to minimize it,” ABB Drives Press Releases Technical Paper, ABB, New Berlin, 2003, pp. 1–7.
- [2] I. Colak, H. Celik, I. Sefa, and S. Demirbas, “On line protection system for induction motors,” *Energy Convers. Manage.*, vol. 46, no. 17, pp. 2773–2786, 2005.
- [3] A. Siddique, G. S. Yadava, and B. Singh, “A review of stator fault monitoring techniques of induction motors,” *IEEE Trans. Energy Convers.*, vol. 20, no. 1, pp. 106–114, Mar. 2005.
- [4] Y. Zhongming and W. Bin, “A review on induction motor online fault diagnosis,” in *3rd Int. Power Electron. Motion Control Conf. (PIEMC 2000)*, vol. 3, pp. 1353–1358.
- [5] M. E. H. Benbouzid, “Bibliography on induction motors faults detection and diagnosis,” *IEEE Trans. Energy Convers.*, vol. 14, no. 4, pp. 1065–1074, Dec. 1999.
- [6] N. Tandon, G. S. Yadava, and K. M. Ramakrishna, “A comparison of some condition monitoring techniques for the detection of defect in induction motor ball bearings,” *Mech. Syst. Signal Process.*, vol. 21, no. 1, pp. 244–256, Jan. 2007.
- [7] F. Filippetti, G. Franceschini, C. Tassoni, and P. Vas, “AI techniques in induction machines diagnosis including the speed ripple effect,” *IEEE Trans. Ind. Appl.*, vol. 34, no. 1, pp. 98–108, Jan./Feb. 1998.
- [8] W. T. Thomson, D. Rankin, and D. G. Dorrell, “On-line current monitoring to diagnose airgap eccentricity in large three-phase induction motors— Industrial case histories verify the predictions,” *IEEE Trans. Energy Convers.*, vol. 14, no. 4, pp. 1372–1378, Dec. 1999.
- [9] W. T. Thomson and M. Fenger, “Current signature analysis to detect induction motor faults,” *IEEE Ind. Appl. Mag.*, vol. 7, no. 4, pp. 26–34, Jul./Aug. 2001.
- [10] M. Benbouzid, M. Vieira, and C. Theys, “Induction motor’s fault detection and localization using stator current advanced signal processing techniques,” *IEEE Trans. Power Electron.*, vol. 14, no. 1, pp. 14–22, Jan. 1999.
- [11] M. Arkan, D. Kostic-Perovic, and P. J. Unsworth, “Modelling and simulation of induction motors with inter-turn faults for diagnostics,” *Electr. Power Syst. Res.*, vol. 75, no. 1, pp. 57–66, Jul. 2005.
- [12] M. M. Hodowanec, W. R. Finley, and S. W. Kreitzer, “Motor field protection and recommended settings and monitoring,” in *Proc. Ind. Appl. Soc.*
- [13] W. A. Farag and M. I. Kamel, “Microprocessor-based protection system for three-phase induction motors,” *Electr. Mach. Power Syst.*, vol. 27, pp. 453–464, 1999.



## Author Profile



**Yogesh Godhwani** received the B.E. in Electrical Engineering from Government College Of Engineering, Bilaspur in 2010 and M.Tech. in Electrical Engineering from Priyadarshini College Of Engineering in 2012. During 2012-2013, he worked as a lecturer in Gurunanak Institute of Engineering & Technology, Nagpur. After that he worked as an Assistant Professor in Rajiv Gandhi College of Engineering & Research, Nagpur from 2014-2015. He now is working as an assistant professor in Pragati college of engineering & management, Raipur.



**Sachin Dev Barman** received the B.E. in Electrical Engineering from Government College Of Engineering, Bilaspur in 2010 and M.Tech. in Power control & drives from National Institute of Technology, Rourkela in 2013. He worked as an assistant professor in Central Institute of Technology, Raipur, during 2013-2014. He now is as an assistant professor working in Pragati college of engineering & management, Raipur.



**Dr. Sushil Kumar** did his BE, ME and Phd in electrical engineering. He has around 28 years of teaching experience. He has more than 50 research papers to his credit in International and National journals and conferences. He guided to 2 Phd and 12 Mtech projects.